



**CLEAN DEVELOPMENT MECHANISM
PROJECT DESIGN DOCUMENT FORM (CDM-PDD)
Version 03 - in effect as of: 28 July 2006**

CONTENTS

- A. General description of project activity
- B. Application of a baseline and monitoring methodology.
- C. Duration of the project activity / crediting period
- D. Environmental impacts
- E. Stakeholders' comments

Annexes

- Annex 1: Contact information on participants in the project activity.
- Annex 2: Information regarding public funding
- Annex 3: Baseline information
- Annex 4: Monitoring plan

**SECTION A. General description of project activity****A.1. Title of the project activity:****Düzova Wind Power Project, Turkey**

Document Version: 10

Date of completion: 02 July 2012

A.2. Description of the project activity:

Ütopya Elektrik Üretim Sanayi ve Tic. A.Ş. (Ütopya or project owner) invests into a new wind power plant i.e. Düzova WEPP (Düzova) and granted production licence by EMRA on May 2007 for 15 MW, and amended to 30 MW on April 2010.

An amendment on Licence Regulation on 11 August 2011¹, gave right to the project owner to increase mechanical installed capacity of the power plant, provided that electrical power capacity to be fed into the grid shall not exceed the electrical installed capacity stated in the licence (30 MWe) and additional turbines shall be built in the project area. By utilizing this provision, project owner decided to add four new turbines to the project activity in the project area. After addition of 4 new turbines, the total electrical power capacity of the power plant will be capped to 30 MWe during the operation, but installed mechanical capacity will be increased to 40 MWm. Addition of 4 new turbines to the existing power plant will increase utilization rate of the 30 MWe capacity and therefore increase the annual energy generation of the power plant. Moreover, one of the existing turbine (WTG 7) will be moved to a new spot, as utilization rate in current position is not good. New coordinates for WTG 7 is presented in Table-1.

The purpose of the project is to generate electricity and to feed it into the public grid. Düzova project shall be registered as a Voluntary Emission Reduction project in order to enable the project implementation by means of financial inflows coming from the credits sale. Because of its significant contribution to climate protection and to sustainable development in the region, this project is expected to fulfill the requirements of the Gold Standard.

Installed Capacity of Düzova WEPP is 30 MWe and 40 MWm with 16 turbines each having 2.5 MW capacity. First 6 turbines with 15 MW capacity was put in operation on 11/08/2009. Additional 6 turbines with 15 MW capacity has been put in operation on 01/09/2010, and installed capacity reached to 30 MW. 4 new turbines is planned to be added to the power plant without any increase in the 30 MW electrical capacity. Two new turbines will be in operation by August 2012 and other two new turbines will be in operation by May 2013.

Annual energy yield of the first 6 turbines was estimated to be 59,300 MWh and 12 turbines was estimated to be 118,600 MWh². However, a new energy yield study, performed by GL Garrad Hassan on 19 December 2011 has concluded with an estimation of 97,200 MWh/yr annual generation for the case of 30 MW and 12 turbines. This figure is in line with actual electricity generation of the first operation year of the power plant

¹ See: <http://www.epdk.org.tr/documents/10157/4282ee6d-0518-4e82-be91-8303f682569d> (page 16, Article 13-(11))

² See PDD v.8: <https://gs2.apx.com/mymodule/ProjectDoc/EditProjectDoc.asp?id1=672> (section A.2)



with 30 MWe (Sept-10/Aug-11), which is 97,349 MWh³. Actual generation shows that estimated electricity generation amount in feasibility report was higher. Same study of GL Garrad Hassan (performed on December 2011), estimates annual generation for the power plant after addition of 4 new turbines (30 MWe and 40 MWm) to be 118,100 MWh/yr. Thus all electricity generation figures in PDD is revised in accordance with this figure.

Proposed project activity will generate electricity using renewable wind energy and will transfer to the national electricity system (grid).

The project will help Turkey to stimulate and commercialise the use of grid connected renewable energy technologies and markets. Furthermore, the project will demonstrate the viability of grid connected wind farms which can support improved energy security, improved air quality, alternative sustainable energy futures, improved local livelihoods and sustainable renewable energy industry development. The specific goals of the project are to:

- reduce greenhouse gas emissions in Turkey compared to the business-as-usual scenario;
- help to stimulate the growth of the wind power industry in Turkey;
- create local employment during the construction and the operation phase of the wind farm;
- reduce other pollutants resulting from power generation industry in Turkey, compared to a business-as-usual scenario;
- help to reduce Turkey's increasing energy deficit;
- and differentiate the electricity generation mix and reduce import dependency.

The emission reductions will be generated by substituting electricity produced from the conventional mix representing electricity generation for the Turkish grid, which to a relevant extent depends on fossil fuels. The emission reductions will be calculated based on the Combined Margin (CM) emission factor.

Other than the objective of climate change mitigation through significant reduction in greenhouse gas (GHG) emissions, the project has been carried out to provide social and economical contribution to the region in a sustainable way. The benefits that will be gained by the realization of the project compared to the business-as-usual scenario can be summarized under four main indicators:

Environmental

In the absence of the project activity, an equivalent amount of electricity would have to be generated from the power plants connected to the grid, majority of which are based on fossil fuels. Thus the project is replacing the anthropogenic emissions (CO₂, CH₄) and other pollutants (SO_x, NO_x, particulate matters) occurring from extraction, processing, transportation and burning of fossil fuels for power generation connected to the national grid. Also, by reduction in the consumption of these fuels, it contributes to conservation of water, soil, plant and animal ecosystems and transfers these natural resources and also the additional supply of these primary energy sources to the future generations.

Economical

The project will help to accelerate the growth of the wind power industry and stimulate the designation and production of renewable energy technologies in Turkey. Other entrepreneurs irrespective of sector will be encouraged to invest in wind power. It will assist to reduce Turkey's increasing energy deficit and diversify

³ See second monitoring report of Duzova WEPP:
<https://gs2.apx.com/mymodule/ProjectDoc/EditProjectDoc.asp?id1=672>



the electricity generation mix while reducing import dependency. Rural development will be maintained in the areas around the project site by providing infrastructural investments to these remote villages.

Social

The project will enhance local employment during the construction and the operation phase of the wind farm and result in alleviation of poverty and unemployment by increased job opportunities in a diversified range from engineers to simple workers in the vicinity of the project area. Construction materials for the foundations, cables and other auxiliary equipment will preferentially be sourced locally. Rural electrification will be more reliable, available and cost efficient thanks to the decreasing distances between the generation and consumption points.

Technological

Implementation of the proposed project will contribute to wider deployment of wind power technology on the local and national level. It will demonstrate the viability of larger grid connected wind farms, which will support improved energy security, alternative sustainable energy, and also renewable energy industry development.

The “do no harm assessment“ table and “sustainable development“ matrix in the Gold Standard Passport provide detail information about the project’s contribution to sustainable development in the light of Local Stakeholder Consultation meeting results and Environmental Impact Assessment report. The results from the in-depth assessment of environmental and social impacts confirm the positive influence of the project on all the discussed domains.

A.3. Project participants:

Name of Party involved (*) (host) indicates a host Party)	Private and/or public entity(ies) project participants (*) (as applicable)	Kindly indicate if the Party involved wishes to be considered as project participant (Yes/No)
Turkey (host country)	Ütopya Elektrik Üretim Sanayi ve Tic. A.Ş.	No

Ütopya Elektrik Üretim Sanayi ve Tic. A.Ş. is project developer and owner of the project.

Equipment Supplier of this project activity (GE) is not project participant.

The Republic of Turkey is the host country. Turkey ratified the Kyoto Protocol (on 5th February of 2009) and put in effect on 13th May 2009⁴. Turkish National Focal Point to the UNFCCC is the Ministry of Environment and Forestry⁵.

A.4. Technical description of the project activity:

A.4.1. Location of the project activity:

A.4.1.1. Host Party(ies):

⁴ See Official Gazette,

<http://rega.basbakanlik.gov.tr/main.aspx?home=http://rega.basbakanlik.gov.tr/eskiler/2009/05/20090513.htm&main=http://rega.basbakanlik.gov.tr/eskiler/2009/05/20090513.htm>

⁵ UNFCCC, list of the National Focal Points <http://maindb.unfccc.int/public/nfp.pl?mode=wim> (accessed in May 2009)



The host country is Republic of Turkey.

A.4.1.2. Region/State/Province etc.:


The project will be in Aegean Region and province of Izmir in Turkey.

A.4.1.3. City/Town/Community etc.:

The project will be situated in the district of Bergama and near Aşağıkırklar village.

A.4.1.4. Details of physical location, including information allowing the unique identification of this project activity (maximum one page):

The project site is located in the Aşağıkırklar village, Bergama district, İzmir city, Turkey. The project area is completely plain area without any trees. There are not any agricultural activities on proposed project area. Location of the project and the specific positions of the 16 wind turbines are presented on the following map.

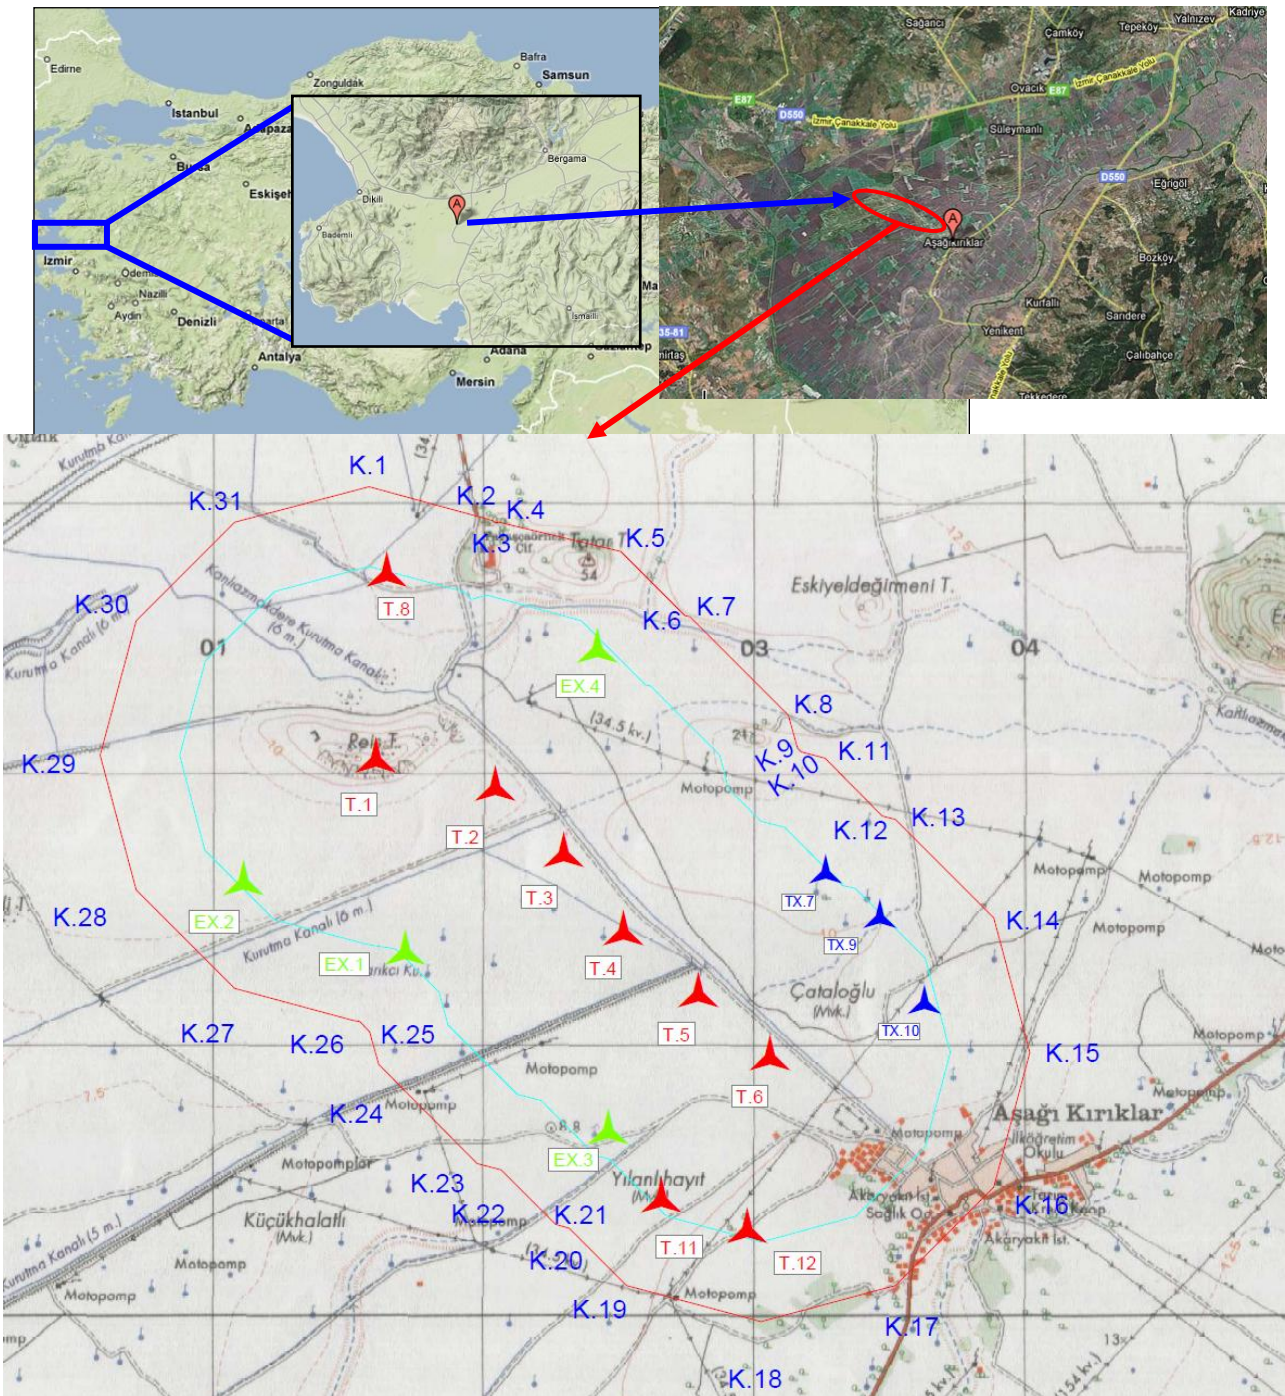

Map 1 Location of the project and the specific positions of the 16 wind turbines

The geographical coordinates (coordinate system ED50, Zone 35) of the turbines of the project activity are presented in the table below.

Table 1 Geographical coordinates of the wind turbines of the project activity

Wind Turbine	Latitude (N)	Longitude(E)
WTG 1 (T.1)	39° 2' 51.133"	27° 1' 5.524"



WTG 2 (T.2)	39° 2' 47.659"	27° 1' 23.619"
WTG 3 (T.3)	39° 2' 39.806"	27° 1' 34.267"
WTG 4 (T.4)	39° 2' 30.169"	27° 1' 42.874"
WTG 5 (T.5)	39° 2' 22.835"	27° 1' 54.976"
WTG 6 (T.6)	39° 2' 15.500"	27° 2' 5.871"
WTG 7 (TX.7)	39° 2' 36.940"	27° 2' 15.741"
WTG 8 (T.8)	39° 3' 12.641"	27° 1' 7.859"
WTG 9 (TX.9)	39° 2' 26.619"	27° 2' 30.502"
WTG 10 (TX.10)	39° 2' 15.426"	27° 2' 34.073"
WTG 11 (T.11)	39° 1' 57.532"	27° 1' 50.306"
WTG 12 (T.12)	39° 1' 54.025"	27° 2' 3.240"
WTG 13 (EX.1)	39° 2' 27.516"	27° 1' 11.175"
WTG 14 (EX.2)	39° 2' 35.759"	27° 0' 46.425"
WTG 15 (EX.3)	39° 2' 6.001"	27° 1' 42.490"
WTG 16 (EX.4)	39° 3' 3.713"	27° 1' 40.807"

A.4.2. Category(ies) of project activity:

Using the list of categories of project activities and of registered CDM project activities by category available on the UNFCCC CDM web site⁶, Duzova WEPP falls in:

Scope number : 1

Sectoral scope : Energy industries, renewable sources.

A.4.3. Technology to be employed by the project activity:

The Düzova project will consists of 16 wind turbines GE 2.5xl⁷ model turbines with 2.5 MW output each having 100 m diameter, 7,854 m² swept area and 85 m hub height. The wind turbines will be connected to the wind farm substation through 34.5 kV underground cables. The voltage is raised to 154 kV and is transferred to grid via a 3 km long transmission line which is connected to the bypassing Bergama-Ayvalık transmission line of TEIAS. The entire net electricity production is expected to be around 118,100 MWh per year.

Harnessing the wind energy to generate electricity by three blades turbines is reliable and proven technology which starts to be used widely since 1980s. There are enormous amount of wind turbines operating all over the world integrated with the environment. Also, according to manufacturer of the turbines (GE)⁸ *'With technology centers of excellence in the United States, Europe, India and China, our teams of engineers and scientists use Six Sigma methodology, coupled with the latest computational modeling and power electronic analysis tools, to manufacture wind turbines with the reliability, efficiency and maintainability necessary to meet the challenges our customers face in today's energy environment.'* Therefore, environmentally safe and sound technology and know how is being applied by the project activity interalia technology transfer.

The project activity will achieve emission reductions by avoiding CO₂ emissions from the business-as-usual scenario electricity generation produced by mainly fossil fuel-fired power plants within the Turkish national grid (Figure 2).

⁶ For List of Sectoral Scopes see: <http://cdm.unfccc.int/DOE/scopelst.pdf>, page 1

⁷ See http://www.gepower.com/prod_serv/products/wind_turbines/en/downloads/ge_25mw_brochure.pdf (page 3)

⁸ See, http://www.gepower.com/prod_serv/products/wind_turbines/en/downloads/ge_25mw_brochure.pdf (page 4)

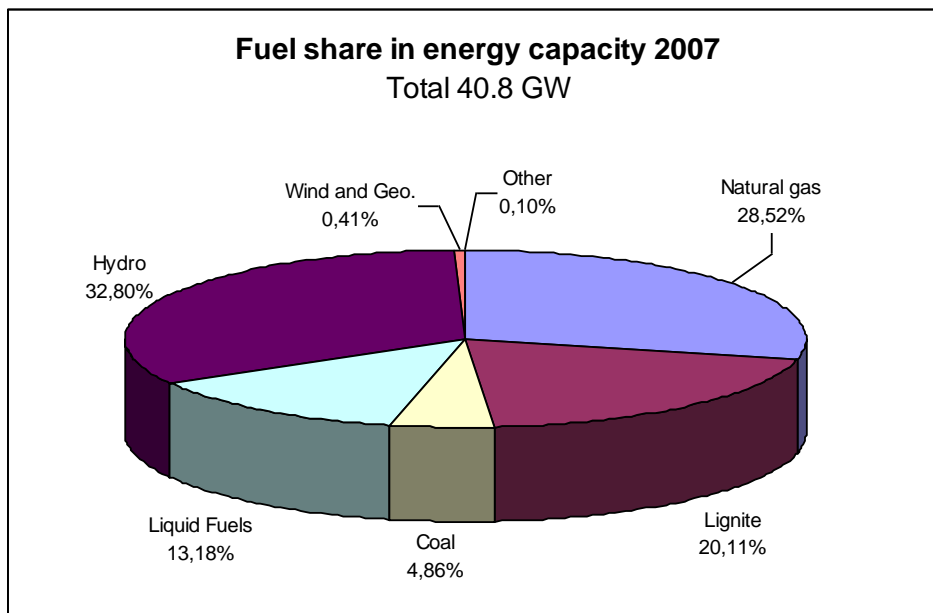


Figure 1 Share of Installed Capacity by Fuel Types in Turkey in 2007⁹

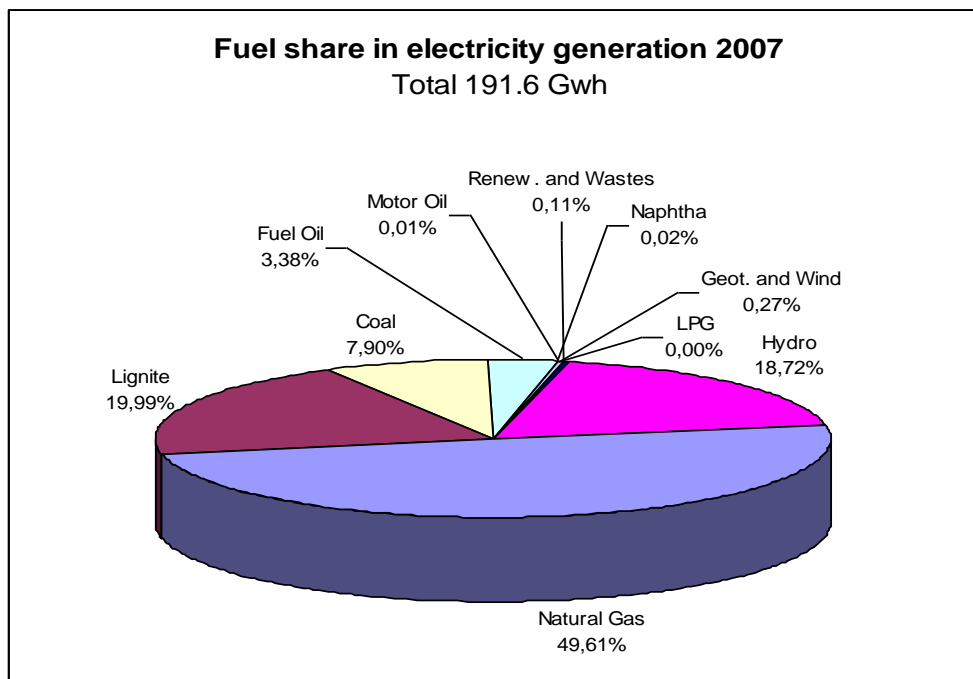


Figure 2 Share of Electricity Generation by Fuel Types in Turkey in 2007¹⁰

As it can be seen from Figure 1 and Figure 2, hydropower is the only major zero-emissions primary energy source at the moment in Turkey. The share of non-hydro renewables (geothermal, wind, biomass) with its 210 MW capacity makes only 0.38 percent of total generation. Fossil fuels comprise the 80.9% of the total gross electricity generation for the year of 2007. Also noteworthy is the trend in the renewables share:

⁹ See, TEİAŞ, Annual Development of Turkey's Installed Capacity by Primary Energy Resources (1984-2007), <http://www.TEIAS.gov.tr/ist2007/3.xls> (Multi fuel fired PPs are grouped in liquid fuel fired plants for the sake of simplicity)

¹⁰ See, TEİAŞ, Annual Development of Turkey's Gross Electricity Generation of Primary Energy Resources (1940-2007), [http://www.TEIAS.gov.tr/ist2007/31\(40-07\).xls](http://www.TEIAS.gov.tr/ist2007/31(40-07).xls)



today's 19.3 percent share of renewables compares to 40 percent in 1990.¹¹ But more important for the justification of effective emission reductions by the proposed project activity is a glance at the future trend. While the share of fossil fuel in electricity generation is forecasted by the TEİAŞ to be 75.5% in 2018, the share of non-hydro renewables is expected to increase only to 1.5 % in 2018 from the current level of 0.38 %.¹²

Although Turkey has a very good wind resource, substantial space, a reasonably good electrical infrastructure and an approaching shortage of electricity; it uses negligible capacity (less than 2%) of its onshore potential, which is estimated as 53,000 MW by Ministry of Energy and Natural Resources (MENR).¹³ Lack of attractive incentives and tax advantages, limited grid access and restricted turbine supply constitutes the major barriers in front of the wind energy.

Renewable energy law, enacted in 2005, which had amendments in 2007 regarding feed-in tariffs, stipulates a purchase obligation by the retail companies for 10 years with a purchase price between 5 and 5.5 € ¢ /kWh. This tariff is much below the average remuneration in the leading wind markets and does not constitute a sufficient incentive for investments in little experienced wind energy sector of Turkey. The revenues calculated according to these regulations are considered in the investment planning of the projects and do not lead to returns that let the project be profitable or attractive for capital investors and lenders.

These numbers and figures show the contribution of a wind power project like Düzova to the development of environmental friendly electricity generation instead of above described Turkish mix of hydroelectric and fossil fuelled power plants which are better known and financially more attractive from an investor's point of view. The emission reductions would not occur in the absence of the proposed project activity because of various real and perceived risks that impede the provision of financing.

Düzova WEPP, as a wind power plant project, will serve as a perfect project to demonstrate long-term potential of wind energy as a means to efficiently reducing GHG emissions as well as to diversifying and increasing security of the local energy supply and contributing to a sustainable development. Wind driven turbines will rotate in generators and electricity generated here will be transferred to the grid for consumer without any greenhouse gas emissions. The Gold Standard certification shall help to realize this seminal technology by providing an adequate compensation for the lacking financial incentives in the Turkish renewable energy market.

A.4.4. Estimated amount of emission reductions over the chosen crediting period:

Table 2: Estimated amount of emission reductions over the crediting period

Years	Annual estimation of emission reductions [tCO₂e]
2009*	13,383
2010**	63,158
2011	71,072
2012	71,072
2013	71,072
2014	71,072
2015	71,072

¹¹ See, TEİAŞ, [http://www.TEİAŞ.gov.tr/ist2007/31\(40-07\).xls](http://www.TEİAŞ.gov.tr/ist2007/31(40-07).xls)

¹² See, EPDK, http://www.epdk.org.tr/yayin_rapor/elektrik/yayin/uretimKapasiteProjeksiyonu2008_2017.pdf, page 50

¹³ See, Presentation of Zeynep Günaydın from MENR, http://www.senternovem.nl/mmfiles/MENR_tcm24-287950.pdf page 9



CDM – Executive Board

2016***	44,420
Total emission reductions (tonnes of CO₂ e)	476,321
Total number of crediting years	7 years
Annual average over the crediting period of estimated reductions (tonnes of CO₂e)	68,045

* 4.5 months operation for 2009 with 15 MW installed capacity.

** 8 months operation with 15 MW installed capacity and 4 months operation with 30 MW installed capacity in 2010.

*** 7.5 months operation for 2016 with 30 MW installed capacity.

A.4.5. Public funding of the project activity:

The project activity doesn't have any public funding or Official Development Assistance (ODA) funding.

**SECTION B. Application of a baseline and monitoring methodology****B.1. Title and reference of the approved baseline and monitoring methodology applied to the project activity:**

For the determination of the baseline, the official methodology ACM0002 version 11, “Consolidated baseline methodology for grid-connected electricity generation from renewable sources”¹⁴, approved by the CDM Executive Board on 28 May 2009, is applied, using conservative options and data as presented in the following section. This methodology refers to four Tools, which are:

1. Tool to calculate the emission factor for an electricity system;
2. Tool for the demonstration and assessment of additionality;
3. Combined tool to identify the baseline scenario and demonstrate additionality;
4. Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion.

For baseline calculation the first tool, for additionality assessment the second tool is used. As third tool is the combination of the first and second tool, it is not used. Since no project emission or leakage calculation is required for wind power project fourth tool is not used, either.

B.2. Justification of the choice of the methodology and why it is applicable to the project activity:

The choice of methodology ACM0002 version 11, is justified as the proposed project activity meets its applicability criteria:

- Düzova WEPP is a grid-connected renewable power generation project activity that install a new wind power plant at a site where no renewable power plant was operated prior to the implementation of the project activity (greenfield plant);
- The project does not involve switching from fossil fuels to renewable energy at the site of the project activity;

B.3. Description of the sources and gases included in the project boundary:

The project uses wind energy to produce electricity. Kinetic power of the wind is converted to electrical energy which then will be transferred to the grid. Back-up power generators in the wind farm will only be used when the wind farm is out of service and power cannot be supplied from grid. Hence, emissions due to usage of back-up power generation are expected to be very low and are taken to be zero complying to the Tool.

A general operation diagram of the project is given in Figure 3:

¹⁴ ACM0002 Version 11: (<http://cdm.unfccc.int/UserManagement/FileStorage/HGY3TLRFQVM016WA4I7XCZD92KE5S>)

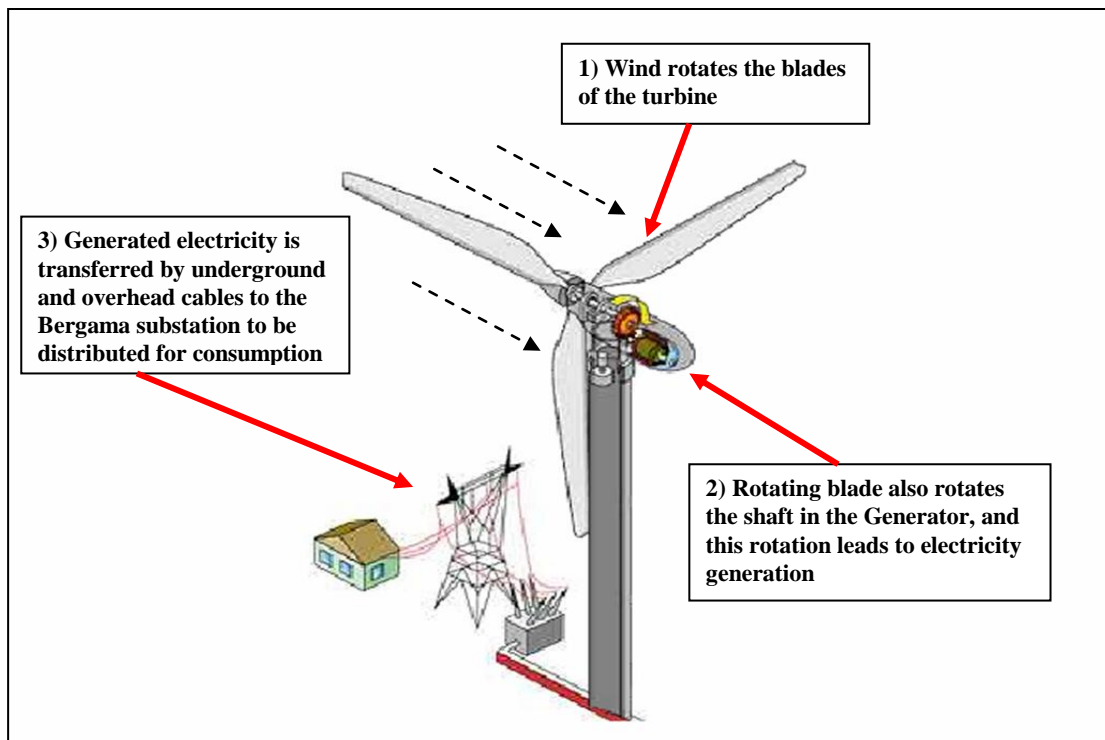


Figure 3 Operation diagram of the project

Based on the above operation diagram, the baseline and project activity related greenhouse gases which are considered in baseline calculation is given below, in Table 3:

Table 3 Emissions sources included in or excluded from the project boundary

Source		Gas	Included?	Justification/Explanation
Baseline	CO ₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity	CO ₂	Yes	<i>Main emission source:</i> Fossil fuels fired for electricity generation cause CO ₂ emissions. It is included to baseline calculation to find the displaced amount by the project activity.
		CH ₄	No	<i>Minor emission sources:</i> Even though there may be some CH ₄ and N ₂ O emissions during electricity generation, these emissions are negligible and not included in baseline calculation to be conservative and comply with Table-1 of the methodology (page 5).
		N ₂ O	No	
Project Activity	Emissions during construction and operation of the project activity	CO ₂	No	<i>Minor emission source</i>
		CH ₄	No	<i>Minor emission source</i>
		N ₂ O	No	<i>Minor emission source</i>

B.4. Description of how the baseline scenario is identified and description of the identified baseline scenario:

The baseline scenario is identified according to the “Baseline Methodology Procedure” of ACM0002 ver.11 (page 4). The project activity is installation of a new grid-connected wind farm and is not modification/retrofit of an existing grid-connected power plant. So, first identification of this procedure is selected for proposed project activity, which is described as:

“Electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources, as reflected in the combined margin (CM) calculations described in the “Tool to calculate the emission factor for an electricity system”.

To describe the baseline and its development for the project activity, long term electricity demand and supply projections for Turkey are assessed.

Demand for electricity in Turkey is growing rapidly with average 6.11%¹⁵ for previous ten years. TEİAŞ, who is responsible from the grid reliability has prepared an electricity demand projection for next ten years period (2008-2017) for Turkey and announced on June 2008, given in Table 4, reflecting the continuation of current demand growth.¹⁶

Table 4 Low and Base Demand Scenarios for Ten Years Period (TWh)

Scenarios	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017
Low Scenario	204.0	217.0	230.7	246.2	262.7	280.3	299.1	319.2	340.4	363.0
Base Scenario	204.0	219.0	236.2	253.8	272.8	293.2	315.1	338.7	363.7	390.6

In this projection, electricity generation capacity additions are also forecasted taking into account all power plants which are operational, under construction and newly licensed. Generation capacity projection is given in Table 5:

Table 5 Projection of Total Generation Capacity by Fuel Types (TWh)

YEARS	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	SHARE IN 2017 (%)
LIGNITE	52.6	52.6	52.4	54.0	55.6	55.7	55.7	55.5	55.6	55.6	18.1%
HARDCOAL	3.0	4.0	5.1	5.1	5.1	5.1	5.1	5.1	5.1	5.1	1.6%
IMPORTED COAL	11.7	11.5	11.5	15.3	21.2	23.8	23.3	23.6	24.3	23.8	7.8%
NATURAL GAS	107.9	109.2	113.4	115.7	122.1	121.7	120.6	121.3	121.9	119.1	38.8%
GEOTHERMAL	0.3	0.5	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.2%
FUEL OIL	14.0	11.1	10.5	10.5	10.5	10.5	10.5	10.5	10.5	10.5	3.4%
DIESEL	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4	0.4%
OTHER	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	0.5%
THERMAL TOTAL	192.5	191.9	196.4	204.1	218.0	220.3	218.8	219.5	220.9	217.6	70.9%
BIOGAS+WASTE	0.1	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.1%
HYDRO	47.2	50.8	59.3	68.6	75.6	80.3	85.9	87.5	86.7	85.5	27.9%
WIND	1.4	2.9	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	1.2%

¹⁵ For demand development see, TEİAŞ, <http://www.TEİAŞ.gov.tr/projeksiyon/KAPASITE%20PROJEKSIYONU%202008.pdf> (page 4, Table 1)

¹⁶ See, TEİAŞ, (<http://www.TEİAŞ.gov.tr/projeksiyon/KAPASITE%20PROJEKSIYONU%202008.pdf> page 50, Table 26)

TOTAL	241.3	245.8	259.5	276.6	297.5	304.4	308.6	310.8	311.4	307.0	100.0%
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	--------

It is clear from above table that at least for 10 years fossil fuels will be the main resource for electricity generation with 70.9% share in 2017. Natural Gas will continue to hold the dominance and total imported fuel will still constitutes significant share with 50.9%. However, non-hydro renewables constitutes only 1.3%, hydro included is 29.2% of energy mix in 2017. This projection is consistent with continuing fossil fuel dependent characteristics of Turkish electricity sector, which is given in Figure 4. Fossil fuels are generally takes higher shares of Turkish electricity generation from 1970s and there is a clear increasing trend since the beginning of 1990s which comes to 80.9% as the year of 2007.

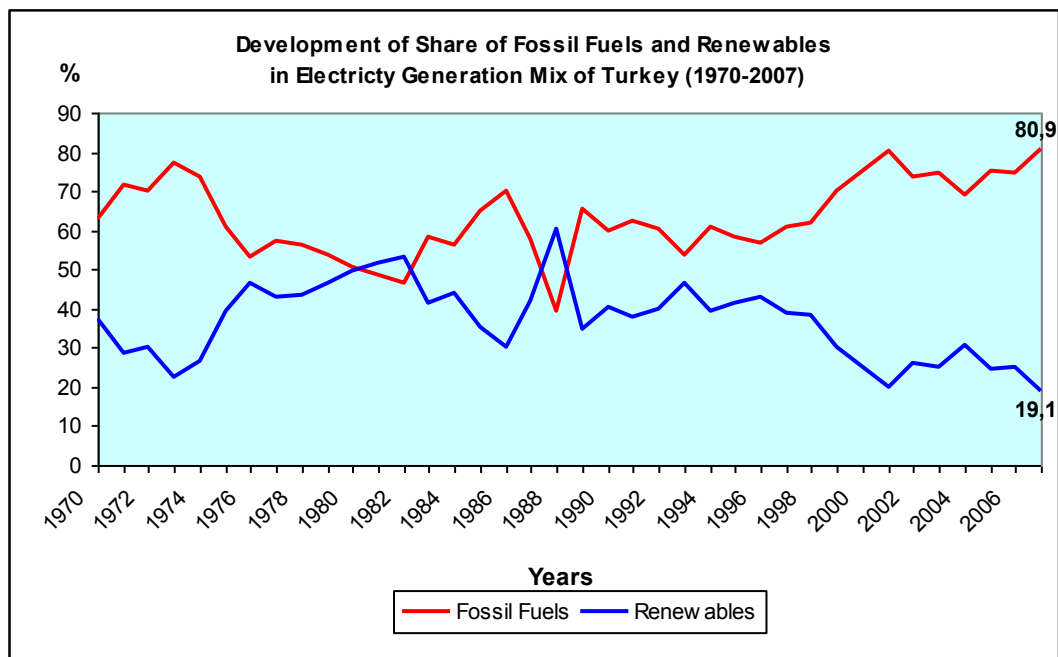


Figure 4 Development of Fossil Fuels and Renewables Shares in Turkey (1970-2007)¹⁷

In the shed of above analysis for the baseline scenario (continuation of current situation) we can conclude that:

- a) Energy demand in Turkey has been increasing with significant rates since ten years, and it is expected to continue at least for ten years.
- b) Even all operational plants, construction phase plants and licensed ones are taken into account lack of supply is projected after the year of 2014. Some other scenarios in the study of TEİAŞ, projects lack of supply starting with the year of 2009.¹⁸. So, there is significant need for electricity generation investments to satisfy demand.
- c) Fossil fuels will hold the dominance in generation mix for at least midterm period with 70% share. Hydro included renewables will remain low with 29.2% share and wind energy contribution will stay negligible with only 1.2% of total share.

¹⁷ TEİAŞ, <http://www.TEİAŞ.gov.tr/ist2007/32.xls> (Renewable generation is composing of ‘renewable and waste’, ‘hydro’ and ‘geothermal and wind’ data)

¹⁸ See, Ten Years Projection for Electricity Generation Capacity (2008-2017), <http://www.TEİAŞ.gov.tr/projeksiyon/KAPASITE%20PROJEKSIYONU%202008.pdf> page 104

**B.5. Description of how the anthropogenic emissions of GHG by sources are reduced below those that would have occurred in the absence of the registered CDM project activity (assessment and demonstration of additionality):**

For the explanation of how and why the project activity leads to emission reductions that are additional to what would have occurred in the absence of the project activity, the Gold Standard Toolkit (page 34, Table 2.4) refers to the “Tool for the demonstration and assessment of additionality version 05.2”¹⁹ (Tool), which defines a step-wise approach to be applied to the proposed project.

Step 1. Identification of alternatives to the project activity consistent with current laws and regulations.

Sub-step 1a. Alternatives to the project activity

To identify the realistic and credible alternative scenario(s) for project participants, scenarios in the Tool are assessed:

P1: The proposed project activity undertaken without being registered as a GS VER project activity

This alternative is realistic and credible as Ütopya may undertake project activity if he sees no risk for project and/or if the project turns out to be financially attractive without GS VER credit income. However, investments analyze shows that the project is not economically feasible without GS VER credit income. Detail information is given in Step-2c and 2d.

P2: Continuation of the current situation, i.e. Düzova WEPP is not built

The decision in favour or against a project investment depends on the expected revenues and risks, like for every other private investment. Investment decisions other than Düzova WEPP are independent from the question whether Düzova WEPP is built or not. This alternative is also realistic and credible.

According to baseline scenario which is described in B.4, there is a need for energy investment to satisfy increasing demand and if the Düzova WEPP is not built, the same amount of energy will be supplied by other private investors to the grid. Forecasts shows that electricity supplied in the absence of Düzova WEPP will be mainly based on fossil fuels as the projections for the year of 2017 forecasts 70% share for fossil fuels in the energy mix.

P3: Other realistic and credible alternative scenario(s) to the proposed GS VER project activity scenario that deliver electricity with comparable quality, properties and application areas, taking into account, where relevant, examples of scenarios identified in the underlying methodology;

The project activity is the electricity power generation activity without any greenhouse gas emission harnessing the energy of the wind. Being a private entity and licence holder, ÜTOPYA doesn't have to invest power investments even in proposed project activity. Also, since ÜTOPYA has licence only for wind power investment and since in the proposed project area there is no hydro or other sources for electricity generation, other project activities delivering same electricity is *not* realistic for project participant.

Therefore, two realistic and credible alternative scenarios are identified for the project activity:

P1: The proposed project activity undertaken without being registered as a GS VER project activity.

¹⁹ See., http://cdm.unfccc.int/methodologies/PAmethodologies/AdditionalityTools/Additionality_tool.pdf page 4

**P2: Continuation of the current situation, i.e. Düzova WEPP is not built.***Sub-step 1b. Consistency with mandatory laws and regulations*

Both alternatives are in compliance with the following identified applicable mandatory laws and regulations:

- (1) Electricity Market Law²⁰
- (2) Law on Utilization of Renewable Energy Resources for the Purpose of Generating Electricity Energy²¹
- (3) Environment Law²²

Project Implementation Schedule and Early Consideration of VER

Date (DD/MM/YYYY)	Activity
03/05/2007	Issuance of the Licence
15/11/2008	Proposal Requests from Consultants for VER Development
28/01/2009	Signature with FutureCamp GmbH for VER Development
13/02/2009	Holding of LSC Meeting
17/02/2009	Electromechanical Contract Signature with GE
01/06/2009	Starting Erection of first 6 Turbines
11/08/2009	Starting to the Operation of first 6 turbines
20/02/2010	Starting date for construction of <i>additional</i> 6 turbines
08/04/2010	Amendment of licence to 30 MW.
20/05/2010	Issuance of EIA Not Required Certificate for <i>additional</i> 6 turbines
25/05/2010	Electromechanical Contract Signature with GE for <i>additional</i> 6 turbines
01/09/2010	Starting to the Operation of <i>additional</i> 6 turbines
06/01/2012	Issuance of EIA exemption for second design change and application to EMRA for licence amendment
01/03/2012	Amendment of licence to 30 MWe /40 MWm by EMRA
05/04/2012	Construction start date for second design change
01/08/2012	Estimated commercial operation date for the first two turbines for second design change
01/05/2013	Estimated commercial operation date for the third and fourth turbines for second design change

According to Turkish regulations, to get necessary permits for further project implementation, licence issued by EMRA is required. Hence, issuance of licence cannot be considered as 'Project Start Date' but a prerequisite to proceed for further project development activities. Date of contract signature with GE for turbine supply is set to be project starting date since, with this contract ÜTOPYA committed to pay considerable amount of investment cost for this project. You can see from above Implementation Schedule that before starting to the project activity, which is the date of the signature of contract with GE, ÜTOPYA started to analysis of VER, decided to get consultancy for VER development, signed contract with a carbon consultant and held LSC Meeting before the starting to physical construction on site.

²⁰ See: http://www.epdk.gov.tr/mevzuat/kanun/elektrik/elektrik_piyasalari_kanunu.pdf (Enactment Date:2001)

²¹ See: <http://www.epdk.gov.tr/mevzuat/diger/yenilenebilir/yenilenebilir.doc> (Enactment Date: 2005)

²² See: <http://www2.cevreorman.gov.tr/yasa/k/2872.doc> (Enactment Date: 1983)



Aforementioned schedule shows us that ÜTOPYA started to consideration of VER from the beginning of the project implementation and VER Revenue has decisive impact on decision of proceeding to the project.

In the following, the investment analysis is applied to clearly demonstrate that the project activity is unlikely to be financially/economically attractive without the revenue from the sale of VERs.

Step 2. Investment analysis

Sub-step 2a: Appropriate analysis method

With the help of the investment analysis it shall be demonstrated that the proposed project activity is not economically or financially feasible without the revenue from the sale of VERs. Therefore, the benchmark analysis shall be applied, as identified alternatives P1 and P2 require benchmark analysis, i.e. there is no alternative project activity for a comparison of the attractiveness of an investment.

Sub-step 2b: Option III: Benchmark analysis

As a common means to evaluate the attractiveness of investment projects and compare them with possible alternatives, the IRR (Internal Rate of Return) shall be used.

According to the Tool, benchmark can be derived from ‘*Estimates of the cost of financing and **required return on capital** (e.g. commercial lending rates and guarantees required for the country and the type of project activity concerned), **based on bankers views and private equity investors/funds***’. As a banker view, according to Worldbank loan appraisal document²³, threshold equity IRR for wind power investments (i.e. required returns of equity for wind power investors) in Turkey is 15%.

Sub-step 2c: Calculation and comparison of the IRR

The IRR is calculated on the basis of expected cash flows (investment, operating costs and revenues from electricity sale), as used in the financial analysis for the feasibility assessment of the project. Calculations are performed for 15 MWe and 30 MWe installed power (both 12 and 16 turbines). In order to be conservative, for investment analysis of 30 MW capacity with 16 turbines case, only turbine costs are considered as additional cost of capacity extension investment.

The parameters and values used for the IRR calculation are available to DOE during validation.

The resulting equity IRRs for 20 years, for both 15 MWe and 30 MWe installed capacity (with 12 turbines and 16 turbines), are stated in below table:

Table 6 Equity IRR values for project activity

Period	IRR – 15 MW	IRR – 30 MW (12 turbines)	IRR – 30 MW (16 turbines)
20 years	8.54%	11.50%	9.01%

²³ Worldbank - Project Appraisal Document on a IBRD Loan and a Proposed Loan from Clean Technology Fund to TSKB and TKB with the Guarantee of Turkey, May 2009 (http://www-wds.worldbank.org/external/default/WDSContentServer/WDSP/IB/2009/05/11/000333037_20090511030724/Rendered/PDF/468080PAD0P12101Official0Use0Only1.pdf page 80, paragraph 29 and page 81, Table 11.5)



Without adding any risk premium to the benchmark, which is 15%, it does clearly exceed the resulting IRRs, thus rendering the project activity economically unattractive.

Sub-step 2d: Sensitivity analysis

While the main parameter determining the income of the project is the electricity sales price, a variation of the accordant value shall demonstrate the reliability of the IRR calculation. Electricity price (EP) is varied according to regulated prices (50 and 55 €/MWh) and an indicative spot price (60 €/MWh). In reality, spot price occurrences are not used in wind project economic analysis by financiers due to high volatility in this price. In addition to the TL based spot price volatility, Euro/TL exchange rate volatility adds more uncertainty to price evolution in spot market as financing of these projects will be Euro base (complete data and figures on spot market prices and exchange rates are available to DOE). Moreover, emerging market conditions (a new Balancing and Settlement Regulation²⁴ will come into force next year which changes price mechanism in spot market) adds further uncertainties to the prices in spot market in mid/long term period.

The investment, energy yield and operating cost parameters are varied with +/- 10%. The worst, base and best case results for each parameter variation is given below, in Table 7. The sensitivity analysis confirms that the proposed project activity is unlikely to be economically attractive without the revenues from VERs as even the maximum IRR result for the best case scenario (11.47% for 15 MWe and 14.63% for 30 MWe, with 12 turbines and 16 turbines cases) is below the benchmark, which is 15%.

Table 7 IRR results according to different parameters (for other parameters 55 €/MWh EP is applied)

Parameter	Electricity Price			Investment Cost			Energy Yield			Operating Cost		
	50	55	60	-10%	0%	10%	-10%	0%	10%	-10%	0%	10%
IRR – 15 MW	5.81%	8.54%	11.27%	9.45%	8.54%	7.73%	5.59%	8.54%	11.47%	9.41%	8.54%	7.65%
IRR – 30 MW (12 turbines)	8.44%	11.50%	14.62%	12.67%	11.50%	10.48%	8.37%	11.50%	14.63%	12.29%	11.50%	10.70%
IRR – 30 MW (16 turbines)	6.06%	9.01%	12.03%	9.98%	9.01%	8.16%	5.97%	9.01%	12.07%	9.81%	9.01%	8.21%

Step 4: Common Practice Analysis

Sub-step 4a. Other activities similar to the proposed project activity

At the moment, 92 production licenses for wind power plants are issued by EPDK, the “Electricity Market Regulation Agency”.²⁵ Work flow of the production projects are different in Turkey comparing with other countries. In many countries, the project developer should grant all other permits to be able to have a production licence. In Turkey, to be able to take some permits like construction and building permits and EIA Not Required certificate the project developer should have production licence. So, even 92 licenses have been issued by EPDK, this doesn’t mean that all these companies have taken investment decision and all these projects will be implemented. It is assessed that, the main intention of license applicants-owners is getting the right of building wind farm on proposed area to have a valuable asset, than they wait for appropriate incentive for wind energy or look for VER credits to get necessary finance to implement these projects.

There are 18 wind projects in operation as May 2009. These projects are given in below table.

²⁴ See, EPDK, <http://www.epdk.org.tr/mevzuat/yonetmelik/elektrik/dengeleme/yeni/duyilk.doc> (accessed in April 2009)

²⁵ See, EPDK, <http://www.epdk.gov.tr/lisans/elektrik/vek/yeklisansgeneltablo.xls> (accessed in April 2009)

**Table 8** The wind projects in operation as May 2009²⁶

NO	Location	Company	Installed Cap. (MW)	Business Model of the Project	GS Project ID
1	İzmir-Çeşme	Alize Enerji Elektrik Üretim A.Ş.	1.50	IPP	-
2	Çanakkale-İntepe	Anemon Enerji Elektrik Üretim A.Ş.	30.40	IPP-VER	GS347
3	Manisa-Akhisar	Deniz Elektrik Üretim Ltd. Şti.	10.80	IPP-VER	-
4	Çanakkale-Gelibolu	Doğal Enerji Elektrik Üretim A.Ş.	14.90	IPP-VER	GS439
5	Manisa-Sayalar	Doğal Enerji Elektrik Üretim A.Ş.	30.60	IPP-VER	GS369
6	İstanbul-Çatalca	Ertürk Elektrik Üretim A.Ş.	60.00	IPP-VER	GS367
7	İzmir-Aliğa	İnnores Elektrik Üretim A.Ş.	42.50	IPP-VER	GS352
8	İstanbul-Gaziosmanpaşa	Lodos Elektrik Üretim A.Ş.	24.00	IPP-VER	GS503
9	İzmir-Çeşme	Mare Manastır Rüzgar Enerjisi Santral San. ve Tic. A.Ş.	39.20	IPP-VER	GS368
10	İstanbul-Hadımköy	Sunjüt Sun'ı Jüt San. ve Tic. A.Ş.	1.20	IPP	-
11	İstanbul-Silivri	Teperes Elektrik Üretim A.Ş.	0.85	IPP	-
12	Balıkesir-Bandırma	Yapısan Elektrik Üretim A.Ş.	30.00	IPP-VER	-
13	Balıkesir-Şamlı	Baki Elektrik Üretim Ltd. Şti.	57.00	IPP-VER	GS351
14	Muğla-Datça	Dares Datça Rüzgar Enerji Santral Sanayi ve Ticaret A.Ş.	17.00	IPP-VER	GS438
15	Hatay-Samandağ	Deniz Elektrik Üretim Ltd. Şti.	20.00	IPP-VER	-
16	Aydın-Didim	Ayen Enerji A.Ş.	31.50	IPP-VER	GS436
17	İzmir-Çeşme	Ares Alaçatı Rüzgar Enerjisi Sant. San. ve Tic. A.Ş.	7.20	BOT	-
18	Çanakkale-Bozcaada	Bores Bozcaada Rüzgar Enj. Sant. San. ve Tic. A.Ş.	10.20	BOT	-

Sub-step 4b: Discuss any similar options that are occurring

Two of the projects given in Table 8 (No. 17 and 18) are realised as BOT (Build Own Transfer) plants, that means stately owned and with guaranteed income which is different model with IPPs as project activity.

Three of the projects given in Table 8 (No. 1, 10 and 11) there are no further information on the circumstances for their implementation, however, due to small capacity; these projects could be considered as R&D investment of the companies and cannot be considered similar activity. Nevertheless, their size alone gives a reason for not including them into the common practice analysis, as the investment risks are far away from those for Düzova.

All other projects given in Table 8 are realised as VER projects. Karakurt²⁷, Bares²⁸ and Sebenoba²⁹ projects (No. 3, 12 and 15) are registered as VER+. All remaining 12 projects are developed as GS-VER projects³⁰.

²⁶ See, EPDK, <http://www.epdk.org.tr/lisans/elektrik/vek/ruzgarprojeleriningelisimi.xls> (accessed in May 2009)

²⁷ See, http://www.netinform.net/KE/Wegweiser/Guide2.aspx?ID=3784&Ebene1_ID=49&Ebene2_ID=1152&mode=4



As shown above, the observed activities in the Turkish wind market can either not be considered similar, as they were realised under a different environment, or do not have to be included in this analysis since they are realised as VER or VER applicants. Thus, no similar options occur, showing that wind power is far from being common practice in Turkey.

Summarizing the explanations above one can state that the commercial risks are high for this project. Taking into consideration the significant technological and investment barriers and barriers due to prevailing practice in conjunction with renewable energies and specifically with wind energy in Turkey, investors are unlikely to invest into the project in the absence of carbon finance.

The emissions reductions from the proposed project are therefore additional to what would have occurred in the absence of the GS-VER project activity.

B.6. Emission reductions:

B.6.1. Explanation of methodological choices:

Baseline scenario is identified and described in B.4. Emission reductions due to project activity will be calculated according to “*Tool to calculate the emission factor for an electricity system*” (Tool)³¹ as indicated in ACM0002 ver. 11.

A brief explanation of this methodology is given in Tool as (page 2): “*This methodological tool determines the CO₂ emission factor for the displacement of electricity generated by power plants in an electricity system, by calculating the “operating margin” (OM) and “build margin” (BM) as well as the “combined margin” (CM). The operating margin refers to a cohort of power plants that reflect the existing power plants whose electricity generation would be affected by the proposed CDM project activity. The build margin refers to a cohort of power units that reflect the type of power units whose construction would be affected by the proposed CDM project activity*”.

Corresponding formulations and calculations of CM factor and emission reductions are shown in B.6.3

B.6.2. Data and parameters that are available at validation:

Data / Parameter:	Gross electricity generation
Data unit:	MWh
Description:	Gross Electricity supplied to the grid by relevant sources (2006-2008)
Source of data used:	Turkish Electricity Transmission Company (TEIAS), Annual Development of Turkey’s Gross Electricity Generation of Primary Energy Resources (1940-2008) TEIAS, see: http://www.teias.gov.tr/istatistik2008/32(75-08).xls
Value applied:	See Table 11
Justification of the	

²⁸ See, http://www.netinform.net/KE/Wegweiser/Guide2.aspx?ID=6081&Ebene1_ID=49&Ebene2_ID=1943&mode=4

²⁹ See, http://www.netinform.net/KE/Wegweiser/Guide2.aspx?ID=3781&Ebene1_ID=49&Ebene2_ID=1116&mode=4

³⁰ See, <https://gs1.apx.com/myModule/rpt/myrpt.asp?r=111>

³¹ See, <http://cdm.unfccc.int/methodologies/PAmethodologies/tools/am-tool-07-v2.pdf> (version 02)



choice of data or description of measurement methods and procedures actually applied :	TEIAS is the national electricity transmission company, which makes available the official data of all power plants in Turkey.
Any comment:	

Data / Parameter:	Net electricity generation
Data unit:	MWh
Description:	Net electricity fed into the grid. Used for the calculation of the net/gross relation (Including Import and Export figures)
Source of data used:	Turkish Electricity Transmission Company (TEIAS), Annual Development of Electricity Generation-Consumption and Losses in Turkey (1984-2008) TEIAS, See http://www.teias.gov.tr/istatistik2008/30(84-08).xls
Value applied:	See Table 12 and Table 13
Justification of the choice of data or description of measurement methods and procedures actually applied :	This data is used to find relation between the gross and net electricity delivered to the grid by fossil fuel fired power plants (Table 12). Import and Export data is used to find total net electricity fed into the grid in the years of 2006, 2007 and 2008 (Table 13) TEIAS is the national electricity transmission company, which makes available the official data of all power plants in Turkey.
Any comment:	

Data / Parameter:	HV_{i,y}
Data unit:	Mass or volume unit
Description:	Heating Values of fuels consumed for electricity generation in the years of 2006, 2007 and 2008
Source of data used:	Heating Values Of Fuels Consumed In Thermal Power Plants In Turkey By The Electric Utilities, TEİAŞ. See: http://www.teias.gov.tr/istatistik2008/46.xls
Value applied:	See Table 18
Justification of the choice of data or description of measurement methods and procedures actually applied :	TEİAŞ is the national electricity transmission company, which makes available the official data of all power plants in Turkey. There is no national NVC data in Turkey. However, TEİAŞ announces Heating values of fuels. This data is used to calculate annual NCVs for each fuel type.
Any comment:	

Data / Parameter:	FC_{i,y}
Data unit:	Mass or volume unit
Description:	Fuels consumed for electricity generation in the years of 2006, 2007 and 2008
Source of data used:	Annual Development of Fuels Consumed In Thermal Power Plants In Turkey By The Electric Utilities, TEİAŞ. See: http://www.teias.gov.tr/ist2007/43.xls



Value applied:	See Table 19
Justification of the choice of data or description of measurement methods and procedures actually applied :	TEİAŞ is the national electricity transmission company, which makes available the official data of all power plants in Turkey.
Any comment:	

Data / Parameter:	$NCV_{i,y}$
Data unit:	TJ/kton, TJ/million m ³
Description:	Net Calorific Value of fuel types in the years of 2006, 2007 and 2008
Source of data used:	Calculated by using $HV_{i,y}$ to $FC_{i,y}$ as Net Calorific Values of fuel types are not directly available in Turkey.
Value applied:	See Table 20
Justification of the choice of data or description of measurement methods and procedures actually applied :	TEİAŞ is the national electricity transmission company, which makes available the official data of power plants in Turkey. Calculation of NCVs from national $HV_{i,y}$ and $FC_{i,y}$ data, Table 18 and Table 19 , is preferred to default IPCC data as these are more reliable.
Any comment:	

Data / Parameter:	Sample Group for BM emission factor
Data unit:	Name of the plants, MW capacities, fuel types, annual electricity generations and dates of commissioning.
Description:	Most recent power plants which compromise 20% of total generation
Source of data used:	Annual Development of Fuels Consumed in Thermal Power Plants in Turkey by the Electric Utilities, TEİAS: For plants in 2004: http://www.teias.gov.tr/istat2004/7.xls For plants in 2005: http://www.teias.gov.tr/istatistik2005/7.xls For plants in 2006: http://www.epdk.org.tr/yayin_rapor/elektrik/yayin/uretimKapasiteProjeksiyonu.pdf (page 76 and 77 for installed power of new plants, page 67-75 for generation amounts. For capacity additions, interpolation method is used for generation amounts) For plants in 2007: http://www.epdk.org.tr/yayin_rapor/elektrik/yayin/uretimKapasiteProjeksiyonu2008_2017.pdf (page 121 and 122 for installed power of new plants, page 111-120 for generation amounts. For capacity additions, interpolation method is used for generation amounts) For plants in 2008: http://www.teias.gov.tr/projeksiyon/KAPASITEPROJEKSIYONU2009.pdf (page 95 for plants and pages 82-94 for generation amounts. For capacity additions, interpolation method is used for generation amounts)
Value applied:	See Table 22
Justification of the choice of data or description of measurement methods and procedures	TEİAS is the national electricity transmission company, which makes available the official data of all power plants in Turkey.



actually applied :	
Any comment:	

Data / Parameter:	EF_i
Data unit:	tCO ₂ /GJ
Description:	Emission factor for fuel type <i>I</i>
Source of data used:	IPCC default values at the lower limit of the uncertainty at a 95% confidence interval as provided in table 1.4 of Chapter1 of Vol. 2 (Energy) of the IPCC Guidelines on National GHG Inventories. http://www.ipcc-nggip.iges.or.jp/public/2006gl/pdf/2_Volume2/V2_1_Ch1_Introduction.pdf
Value applied:	See Table 16 and Table 20
Justification of the choice of data or description of measurement methods and procedures actually applied :	No plant specific and national emission factor data is available in Turkey. So, IPCC default data is used. For Fuel Oil Power Plants: 'Gas/Diesel Oil' data is used for conservativeness. For Coal Power Plants: In the 205 th page of official document given in the link below, it is stated that Çolakoğlu and İçdaş utilizes 'Taşkömürü' (Hardcoal). And at the Table-2 in page 157 of the same document, Taşkömürü is divided in two groups: Bituminous and Anthracite. Since Sub-Bituminous Coal is under Brown Coal in the same table and since Other Bituminous Coal has lower EF than Anthracite in 1.4 of IPCC Guidelines, EF for 'Other Bituminous Coal' is used. See: http://www.dpt.gov.tr/DocObjects/Icerik/4225/Enerji_Hammaddeleri_(Linyit_Taskomuru-Jeotermal)
Any comment:	

Data / Parameter:	$\eta_{i,y}$
Data unit:	-
Description:	Average energy conversion efficiency of power unit <i>m</i> in year <i>y</i>
Source of data used:	TEİAŞ and Annex I of the “Tool to calculate the emission factor for an electricity system”
Value applied:	See Table 16
Justification of the choice of data or description of measurement methods and procedures actually applied :	For Lignite and Coal power plants, plants specific values are applied. There are two lignite power plant in Sample Group. These are Çan and Elbistan PPs. For efficiency factor of Çan PP is taken from presentation of Mr. Sefer Bütün (General Manager of EUAS, state production company), which is ‘Thermal Power Plants and Environment’. This presentation is submitted to DOE. In the page 18 of the presentation, it is stated that for pulverized lignite power plants the highest achieved electrical efficiency rate is 38%. So this rate is applied also for Elbistan-B PP. Weighted average of these efficiency rates, which turns to be 38.63% is used for lignite power plants. For coal power plants, the highest efficiency rate for ‘fluidized bed’ technology which is 41.5% for PFBS is applied as coal PPs in the sample group (Çolakoğlu (Capacity Increment) and Çan Gr I-II) are utilizing fluidized bed type



	<p>technology. For reference see: http://www.mimag-samko.com.tr/akiskan_yatakli_kazanlar.pdf (last paragraph of page 6)</p> <p>For Natural Gas and Oil plants efficiencies, default value given in the tool is applied: http://cdm.unfccc.int/methodologies/Tools/EB35_repan12_Tool_grid_emission.pdf</p>
Any comment:	

B.6.3. Ex-ante calculation of emission reductions:

Emission reductions due to project activity are calculated with stepwise guidance of “*Tool to calculate the emission factor for an electricity system*”.

Step 1. Identify the relevant electric power system

There are 21 regional distribution regions in Turkey but no regional transmission system is defined. In Article 20 of License Regulation it is stated that ‘*TEİAŞ shall be in charge of all transmission activities to be performed over the existing transmission facilities and those to be constructed as well as the activities pertaining to the operation of national transmission system via the National Load Dispatch Center and the regional load dispatch centers connected to this center and the operation of Market Financial Reconciliation Center*³²’. As it can be understood from this phrase, only one transmission system which is national transmission system is defined and only TEİAŞ is in the charge of all transmission system related activities. Moreover, a communication with representative of TEİAŞ which indicates that: “There are not significant transmission constraints in the national grid system which is preventing dispatch of already connected power plants” is submitted to the DOE. Therefore, the national grid is used as electric power system for project activity. The national grid of Turkey is connected to the electricity systems of neighbouring countries. Complying with the rules of the tool, the emission factor for imports from neighbouring countries is considered 0 (zero) tCO₂e/MWh for determining the OM.

There is no information about interconnected transmission capacity investments, as TEİAŞ, who operates the grid, also didn’t take into account imports-exports for electricity capacity projections.³³ Because of that, for BM calculation transmission capacity is not considered.

Step 2: Choose whether to include off-grid power plants in the project electricity system (optional)

According to Tool project participants may choose between the following two options to calculate the operating margin and build margin emission factor:

Option I: Only grid power plants are included in the calculation.

Option II: Both grid power plants and off-grid power plants are included

For this project **Option I** is chosen.

Step 3: Select an operating margin (OM) method

The Turkish electricity mix does not comprise nuclear energy. Also there is no obvious indication that coal is used as must run resources. Therefore, the only low cost resources in Turkey, which are considered as must-run, are Hydro, Renewables and Waste, Geothermal and Wind (according to statistics of TEİAŞ).

Table 9 Share of Low Cost Resource (LCR) Production 2004-2008 (Production in GWh)³⁴

	2004	2005	2006	2007	2008
Gross production	150,698.3	161,956.2	176,299.8	191,558.1	198,418.0
TOTAL LCR Production	46,338.6	39,836.3	44,618.7	36,575.6	34,498.6

³² See, <http://www.epdk.org.tr/english/regulations/electric/license/licensing.doc> (page 21)

³³ See, http://www.epdk.org.tr/yayin_rapor/elektrik/yayin/uretimKapasiteProjeksiyonu2008_2017.pdf (page 39)

³⁴ See, [http://www.teias.gov.tr/istatistik2008/32\(75-08\).xls](http://www.teias.gov.tr/istatistik2008/32(75-08).xls)



Hydro	46,083.7	39,560.5	44,244.2	35,850.8	33,269.8
Renewables and Waste	104.0	122.4	154.0	213.7	219.9
Geothermal and Wind	150.9	153.4	220.5	511.1	1,008.9
Share of LCRs	30.75%	24.60%	25.31%	19.09%	17.39%
Average of last five years	23.43%				

As average share of low cost resources for the last five years is far below 50% (23.43%), the Simple OM method is applicable to calculate the operating margin emission factor ($EF_{grid,OM,y}$)

For the Simple OM method, the emissions factor can be calculated using either of the two following data vintages:

- Ex ante option: A 3-year generation-weighted average, based on the most recent data available at the time of submission of the CDM-PDD to the DOE for validation, or
- Ex post option: The year, in which the project activity displaces grid electricity, requiring the emissions factor to be updated annually during monitoring.

The ex ante option is selected for Simple OM method, with the most recent data for the baseline calculation stemming from the years 2006 to 2008.

Step 4: Calculate the operating margin emission factor according to the selected method

The Simple OM emission factor is calculated as the generation-weighted average CO₂ emissions per unit electricity generation (tCO₂e/MWh) of all generating power plants serving the system, not including low-cost/must-run power plants. The calculation of the simple OM emission factor can be based on:

- data on net electricity generation a CO₂ emission factor of each power unit (Option A), or
- data on the total electricity generation of all power plants serving the system and the fuel types and total fuel consumption of the project electricity system (option B).

Option B is chosen to calculate the Simple OM, as there is no power plant specific data available, renewable power generation are considered as low-cost power sources and amount of electricity supplied to the grid by these sources is known.

Where Option B is used, the simple OM emission factor is calculated based on the electricity supplied to the grid by all power plants serving the system, not including low-cost / must-run power plants, and based on the fuel type(s) and total fuel consumption of the project electricity system, as follows:

$$EF_{grid,OMsimple,y} = \frac{\sum_i FC_{i,y} \times NCV_{i,y} \times EF_{CO_2,i,y}}{EG_y} \quad (1)$$

Where:

- $EF_{grid,OMsimple,y}$ = Simple operating margin CO₂ emission factor in year y (tCO₂/MWh)
- $FC_{i,y}$ = Amount of fossil fuel type i consumed in the project electricity system in year y (mass or volume unit)
- $NCV_{i,y}$ = Net calorific value (of fossil fuel type i in year y (GJ / mass or volume unit)
- $EF_{CO_2,i,y}$ = CO₂ emission factor of fossil fuel type i in year y (tCO₂/GJ)



- EG_y = Net electricity generated and delivered to the grid by all power sources serving the system, not including low-cost / must-run power plants / units, in year y (MWh)
- i = All fossil fuel types combusted in power sources in the project electricity system in year y
- y = three most recent years for which data is available at the time of submission of the PDD to the DOE for validation

For the calculation of the OM the consumption amount and heating values of the fuels for each sources used for the years 2006, 2007 and 2008, is taken from the TEİAŞ annual statistics, which holds data on annual fuel consumption by fuel types as well as electricity generation amounts by sources and electricity imports. All the data needed for the calculation, including the emission factors and net calorific values (NCVs), are provided in Annex 2. Total CO₂ emissions due to electricity generation in Turkey for the years of 2006, 2007 and 2008 are given in Table 10.

Table 10 CO₂ emissions from electricity production 2006-2008 (ktCO₂e)³⁵

	2006	2007	2008
CO₂-Emmissions	82,562	97,649	103,352

Table 11 presents the gross electricity production data by all the relevant energy sources. Low-cost/must run resources like hydro, wind, geothermal and biomass do not emit fossil CO₂ and thus are not taken into account in calculations.

Table 11 Gross electricity production by fossil energy sources 2006-2008 (GWh)

Energy Source	2006	2007	2008
Natural Gas	80,691.2	95,024.8	98,685.3
Lignite	32,432.9	38,294.7	41,858.1
Coal	14,216.6	15,136.2	15,857.5
Fuel Oil	4,232.4	6,469.6	7,208.6
Motor Oil	57.7	13.3	266.3
Naphtha	50.2	43.9	43.6
LPG	0.1	0.0	0.0
Total fossil fuels	131,681.1	154,982.5	163,919.4

Above table shows gross data, but EG_y in the above described formula means electricity delivered to the grid, i.e. net generation, the following table shall help to derive net data by calculating the net/gross proportion on the basis of overall gross and net production numbers.

Table 12 Net/gross electricity production 2006-2008 (GWh)³⁶

	2006	2007	2008
Gross Production	176,299.80	191,558.13	198,418.00
Net Production	169,543.10	183,339.70	189,761.90
Relation	96.17%	95.71%	95.64%

Multiplying these overall gross/net relation percentages with the fossil fuels generation amount does in fact mean an approximation. However this is a conservative approximation as the consumption of plant

³⁵ For detail calculation see Annex 3

³⁶ For Net Production See, [http://www.teias.gov.tr/istatistik2008/30\(84-08\).xls](http://www.teias.gov.tr/istatistik2008/30(84-08).xls) (column L)

auxiliaries of fossil power plants is higher than for the plants that are not included in the baseline calculation. In the end this would lead to a lower net electricity generation and therefore to a higher OM emission factor and higher emission reductions.

Table 13 shows the resulting net data for fossil fuel generation and adds electricity imports.

Table 13 Electricity supplied to the grid, relevant for OM (GWh)

	2006	2007	2008
Net El. Prod. by fossil fuels	126,634.4	148,333.3	156,768.3
Electricity Import	573.2	864.3	789.4
Electricity supplied to grid by relevant sources	127,207.6	149,197.6	157,557.7

Electricity import is added to the domestic supply in order to fulfill the Baseline Methodology requirements. Imports from connected electricity systems located in other countries are weighted with an emission factor of 0 (zero) tCO₂/MWh.

The last step is to calculate $EF_{grid,OMsimple,y}$:

Table 14 Calculation of Weighted $EF_{grid,OMsimple,y}$ (ktCO₂/GWh)

	2006	2007	2008
CO ₂ -Emissions (ktCO ₂)	82,562	97,649	103,352
Net Electricity Supplied to Grid by relevant sources (GWh)	127,207.6	149,197.6	157,557.7
$EF_{grid,OMsimple,y}$ (ktCO ₂ /GWh)	0.6490	0.6545	0.6560
3-year Generation Weighted Average $EF_{grid,OMsimple,y}$ (ktCO ₂ /GWh)	0.6534		

Step 5: Identify the group of power units to be included in the build margin

Build Margin calculations are performed with the sample group of power units *m* consisting of either:

- (a) The set of five power units that have been built most recently, or
- (b) The set of power capacity additions in the electricity system that comprise 20% of the system generation (in MWh) and that have been built most recently

Option (b) is used to identify the sample group, as this option comprises the larger annual generation in Turkey. In 2008, gross electricity generation amount was 198,418 GWh and 20% of this is 39,683.6 GWh.

The last plant of the sample group is built in 2004 and until the end of the 2008 (which is the latest year for official statistics published for plants put in operation) there were 12 VER projects. Because of the last plant of the sample group was built 4 years ago (not more than 10 years ago), VER plants are excluded from sample group.

While identifying the sample group dismantled, revised, retrofits are not included. Only new capacity additions (power plants / units) are taken into account.

Sample group for BM emission factor is given below table. The derivation of the values presented in Table 15 is contained in a separate excel file which is available for validation.

Table 15: Sample group generation for BM emission factor calculation (GWh)

Energy Source	2004	2005	2006	2007	2008	Total
Natural Gas	8,810.4	7,068.4	3,119.1	2,552.1	2,400.0	23,950.5

Lignite	0.0	4,420.0	7,020.0	0.0	0.0	11,440.0
Coal	337.5	1,125.0	0.0	0.0	0.0	1,462.5
Fuel Oil	789.2	99.1	0.0	800.0	103.2	1,791.4
Hydro	241.8	1,028.8	482.6	1,217.0	1,629.0	4,599.2
Renewables	0.0	87.4	453.1	11.0	167.8	719.3
TOTAL	10,178.9	13,828.7	11,074.7	4,580.1	4,300.0	43,962.3

Again, the project proponents can chose between two options according to the calculation tool: calculate the BM ex-ante based on the latest available data or update the BM each year ex post. Option 1, the ex-ante approach, is again chosen.

Step 6: Calculate the build margin emission factor

The build margin emissions factor is the generation-weighted average emission factor (tCO₂/MWh) of all power units *m* during the most recent year *y* for which power generation data is available, calculated as follows:

$$EF_{grid,BM,y} = \frac{\sum_m EG_{m,y} \times EF_{EL,m,y}}{\sum_m EG_{m,y}} \quad (2)$$

Where:

- EF_{grid,BM,y} = Build margin CO₂ emission factor in year *y* (tCO₂/MWh)
- EG_{m,y} = Net quantity of electricity generated and delivered to the grid by power unit *m* in year *y* (MWh)
- EF_{EL,m,y} = CO₂ emission factor of power unit *m* in year *y* (tCO₂/MWh)
- m* = Power units included in the build margin
- y* = Most recent historical year for which power generation data is available

Because of only fuel types and electricity generation data are available for the sample group, *Option B2* of Simple OM method is used to calculate emission factor. The formulation of emission factor is given below:

$$EF_{EL,m,y} = \frac{EF_{CO2,m,i,y} \times 3.6}{\eta_{m,y}} \quad (3)$$

Where:

- EF_{EL,m,y} = CO₂ emission factor of power unit *m* in year *y* (tCO₂/MWh)
- EF_{CO2,m,i,y} = Average CO₂ emission factor of fuel type *i* used in power unit *m* in year *y* (tCO₂/GJ)
- η_{m,y} = Average net energy conversion efficiency of power unit *m* in year *y* (%)
- y* = Three most recent years for which data is available at the time of submission of the PDD to the DOE for validation

BM emission factor calculation and resulted BM factor is given in the Table 16. For BM factor calculation, since no official emission factors for different fuel types are available, lower confidence default values of IPCC Guidelines are applied. Explanation of emission factor selection for each energy sources and references are given in B.6.2 part of the PDD.

Table 16 BM emission factor calculation using equation (2) and (3)

Energy Source	Sample Group Total Generation (GWh)	Effective CO ₂ emission factor (tCO ₂ /TJ)	Average Efficiency (η _{m,v})	CO ₂ Emission (ktCO ₂)
Natural Gas	23,950.0	54.3	60.00%	7,802.9
Lignite	11,440.0	90.9	38.63%	9,691.0
Coal	1,462.5	89.5	41.50%	1,135.5
Fuel Oil	1,791.4	72.6	46.00%	1,017.8
Hydro	4,599.2	0.0	0.00%	0.0
Renewables	719.3	0.0	0.00%	0.0
Total	43,962.3			19,647.2
EF_{grid,BM,y} (tCO ₂ /MWh)	0.4469			

Step 7: Calculate the combined margin emission factor

The combined margin emission factor is calculated as follows:

$$EF_{grid,CM,y} = EF_{grid,OM,y} * w_{OM} + EF_{grid,BM,y} * w_{BM} \quad (4)$$

Where:

- EF_{grid,BM,y} = Build margin CO₂ emission factor in year y (tCO₂/MWh)
- EF_{grid,OM,y} = Operating margin CO₂ emission factor in year y (tCO₂/MWh)
- w_{OM} = Weighting of operating margin emissions factor (%)
- w_{BM} = Weighting of build margin emissions factor (%)

According to the Tool for hydro power generation project activities: w_{OM} = 0.75 and w_{BM} = 0.25 will be applied

Then:

$$EF_{grid,CM,y} = 0.6534 \text{ tCO}_2/\text{MWh} * 0.75 + 0.4469 \text{ tCO}_2/\text{MWh} * 0.25 = 0.6018 \text{ tCO}_2/\text{MWh}$$

Emission reductions are calculated as follows:

$$ER_y = BE_y - PE_y - LE_y \quad (5)$$

Where:

- ER_y = Emission reductions in year y (t CO₂/yr).
- BE_y = Baseline emissions in year y (t CO₂/yr).
- PE_y = Project emissions in year y (t CO₂/yr).
- LE_y = Leakage emissions in year y (t CO₂/yr).

Project emissions



The proposed project activity involves the generation of electricity by development of a wind farm. The generation of electricity does not result in greenhouse gas emissions and therefore is taken as 0 tCO₂/year.

Leakage

The energy generating equipment is not transferred from or to another activity. Therefore leakage does not have to be taken into account and is taken as 0 tCO₂/year.

Then: $ER_y = BE_y$

Baseline emissions

Baseline emissions include only CO₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity, calculated as follows:

$$BE_y = (EG_y - EG_{baseline}) \times EF_{grid,CM,y} \quad (6)$$

Where:

BE_y = Baseline emissions in year y (tCO₂/yr).

EG_y = Electricity supplied by the project activity to the grid (MWh).

$EG_{baseline}$ = Baseline electricity supplied to the grid in the case of modified or retrofit facilities (MWh).

For new power plants this value is taken as zero.

$EF_{grid,CM,y}$ = Combined margin CO₂ emission factor for grid connected power generation in year y calculated using the latest version of the “Tool to calculate the emission factor for an electricity system”.

The project activity is the installation of a new grid-connected renewable power plant so, $EG_{baseline} = 0$

Then:

$$ER_y = BE_y = EG_y * EF_{grid,CM,y}$$

For 15 MW installed capacity: 59,300 MWh/year * 0.6018 tCO₂/MWh = **35,687 tCO₂/year**.

For 30 MW installed capacity: 118,100 MWh/year * 0.6018 tCO₂/MWh = **71,072 tCO₂/year**

B.6.4 Summary of the ex-ante estimation of emission reductions:

Year	Estimation of project activity emissions (tonnes of CO ₂ e)	Estimation of baseline emissions (tonnes of CO ₂ e)	Estimation of leakage (tonnes of CO ₂ e)	Estimation of overall emission reductions (tonnes of CO ₂ e)
2009*	0	13,383	0	13,383
2010**	0	63,158	0	63,158
2011	0	71,072	0	71,072
2012	0	71,072	0	71,072
2013	0	71,072	0	71,072
2014	0	71,072	0	71,072
2015	0	71,072	0	71,072
2016***	0	44,420	0	44,420
Total	0	476,321	0	476,321

* 4.5 months operation for 2009 with 15 MW installed capacity.



** 8 months operation with 15 MW, and 4 months operation with 30 MW installed capacity in 2010.

*** 7.5 months operation for 2016 with 30 MW installed capacity.

B.7. Application of the monitoring methodology and description of the monitoring plan:

B.7.1 Data and parameters monitored:

Data / Parameter:	$EG_{\text{facility},v}$
Data unit:	MWh/yr
Description:	Net electricity delivered to the grid
Source of data to be used:	The data from the Electricity Meter are the basis for the monthly invoice. For monitoring, the monthly invoice – exactly the field where net electricity supplied to the grid is stated – shall be used as source of data.
Value of data applied for the purpose of calculating expected emission reductions in section B.5	For 15 MW installed capacity: 59,300 MWh/year For 30 MW installed capacity: 118,100 MWh/year
Description of measurement methods and procedures to be applied:	<ul style="list-style-type: none"> Regarding the electricity meters: two meters will be placed (one main and one reserve). The fact that two meters are installed in a redundant manner keeps the uncertainty level of the only parameter for baseline calculation low. High data quality of this parameter is not only in the interest of the emission reduction monitoring, but paramount for the business relation between the plant operator and the electricity buyer. Measured hourly and readings monthly: On every month's last day, the production index will be taken from the main as well as the reserve meter: <p><i>“The meters included in the metering system configuration of the settlement aggregation entities registered on the names of the market participants shall be read monthly, within the first 4 (four) days of the month, by TEIAS and/or distribution licensees with participation of the market participant's representative and the meter reading values shall be submitted to MFSC.</i></p> <p><i>The MFSC shall monthly update the list of meters that need to be read as part of the settlement process to reflect new registrants and updates in existing registrations, and send them to TEIAS and the distribution licensees.</i></p> <p><i>The (a) energy withdrawn from the system in kWh, and (b) active energy supplied to the system in kWh for each settlement period of the related invoicing period shall be read from the registered meters.”</i></p> <ul style="list-style-type: none"> A protocol, which shows the measured data (including electricity amount supplied by the plant and received from the grid) will be signed from the WEPP Manager and a responsible person from the State Authorities (TEİAŞ – Turkish Electricity Transmission Company) This protocol will be send to Ankara to Market Financial Settlement Center



	<p>(PMUM in Turkish-PMUM is a governmental organisation and is responsible for determining the spot electricity price)</p> <ul style="list-style-type: none"> • PMUM checks the correctness of the protocol and prepares the invoice until 18th of the following month (PMUM invoices their services like electricity balancing and settlement operations) • In reference to the checked data from the protocol and the PMUM invoice, ÜTOPYA can prepare the invoice for the produced energy. • Since the meters are reading electricity supplied to the system and withdrawn from the system separately, the net electricity amount supplied to the grid will be calculated by electricity supplied minus electricity withdrawn. <p>Thus with this procedure is monitored sufficient and no extra Monitoring has to be implemented.</p> <p>The above described measurement method follows Article 52 of the official regulation “Electricity Market Balancing And Settlement Regulation”³⁷.</p>
QA/QC procedures to be applied:	<p>As stated at the end of the first paragraph of A.2 part of this PDD (page 2), Düzova WEPP will be connected to the grid with 154 kV voltage level. According to the first paragraph of the sub clause b) of Provisional Article 4 of the ‘Communiqué Regarding the Meters to be used in the Electricity Market’³⁸ (Communiqué):</p> <p><i>‘The measurement points of the generation facilities connected to the transmission system transformers over high voltage lines (66 kV, 154kV or 380kV) shall be at the exit side of the group step up transformers of the generation facilities.’</i></p> <p>According to the Article 2 of the Communiqué : <i>‘The meters to be used in the electricity market shall be compliant with the standards of Turkish Standards Institute or IEC and have obtained “Type and System Approval” certificate from the Ministry of Trade and Industry.’</i> Therefore, Ministry of Trade and Industry (Ministry) is responsible from control and calibration of the meters.</p> <p>Paragraph b) of the Article 9 of the ‘Regulation of Metering and Testing of Metering Systems’³⁹ (Regulation) of Ministry states that: <i>‘ b) Periodic tests of meters of electricity, water, coal gas, natural gas and current and voltage transformers are done every 10 years.’</i> Therefore periodic calibration of the meters will be done every 10 years.</p> <p>Also according to Article 67 (page 20) of this regulation, the calibration shall be done in calibration stations which have been tested and approved by Ministry of Trade and Industry. Article 10 d) of Communiqué requires the meters shall be</p>

³⁷ See, <http://www.epdk.org.tr/english/regulations/electric/balancing/balancing.doc> page 50 (accessed in April 2009)

³⁸ See, <http://www.epdk.org.tr/english/regulations/electric/meters.doc>, page 1

³⁹ See, http://www.sanayi.gov.tr/download/osgm/olcu_aletleri_muayene_yonetmelik.zip, page 2



	<p>three phase four wire and Article 64 of Regulation clearly states how calibration shall be performed for this kind of meters.</p> <p>According to Article 3 of System Usage Agreement⁴⁰ done by ÜTOPYA and TEİAŞ; other than periodic tests, if a party alleges the meters are not working appropriately tests of the meters will be done by presence of both parties. If, after controls, it is seen that the meter is not working appropriately, the measurements of reserve meters are taken into account beginning from date both meters are reading the same (page 3, 2-c)</p> <p>As above mentioned, the data acquisition and management and quality assurance procedures that are anyway in place, no additional procedures have to be established for the monitoring plan.</p>
Any comment:	

B.7.2. Description of the monitoring plan:

As the necessary baseline emission factors are all defined ex ante (Operating and Built Margin, see baseline description), the most important information to be monitored is the amount of electricity fed into the grid by Düzova WEPP. This value will be monitored continuously by redundant metering devices, one of them being the main one in the Düzova substation, which provides the data for the monthly invoicing to TEİAŞ.

The collected data will be kept by ÜTOPYA during the crediting period and until two years after the last issuance of VERs for the Düzova WEPP project activity for that crediting period.

Given a data vintage based on ex ante monitoring and selection of a renewable 7 year crediting period, the Combined Margin will be recalculated at any renewal of the crediting period using the valid baseline methodology.

As the proposed project activity does not lead to any project emissions, no data is monitored here.

Potential leakage emissions in the context of power sector projects are emissions arising due to activities such as power plant construction, fuel handling and land inundation. However, according to the methodology, those emission sources do not need to be taken into account.

Operational and Management Structure

As described above, the only relevant data that has to be monitored is the net electricity generation (GEN_y) per year. These data are subject to the accounting quality systems of both parties to the power purchase agreement, TEİAŞ and ÜTOPYA. The monthly meter reading documents are stored by ÜTOPYA and TEİAŞ. The settlement notification, which is issued by TEİAŞ and includes the meter reading data, is stored on a TEİAŞ file server and accessible for ÜTOPYA via a secured website (<http://dgpys.teias.gov.tr/dgpys/>). The meters themselves can always be read as plausibility check for verification. With this, no additional structures or processes have to be implemented to insure the availability and high quality of the necessary data for monitoring.

⁴⁰ See, <http://www.teias.gov.tr/sistemkullanim1.doc> , page 3, 2-b)

Moreover, there are always internal reviews of the meters data which is checked by different parties. First of all, data of the meters is collected by technicians daily in written forms which have to be submitted to local TEIAS center. The data collected daily is saved in plant manager computer and backed up and shared by headquarter of Ütopya in Istanbul. Besides the data that can be get from meters, production amount can be checked from SCADA system of GE.

At the end of each monitoring period, which is planned to generally last one year, the data from the monthly meter reading records will be added up to the yearly net electricity generation and multiplied with the combined margin emission factor with the help of an excel spreadsheet that also contains the combined margin calculation. Thus, the complete baseline approach is always transparent and traceable. For the elaboration and quality assurance of the monitoring report, FutureCamp GmbH, an expert in the project mechanisms who already supported in the project design, is assigned.

For the operation of Düzova wind power plant, below hierarchy is planned:

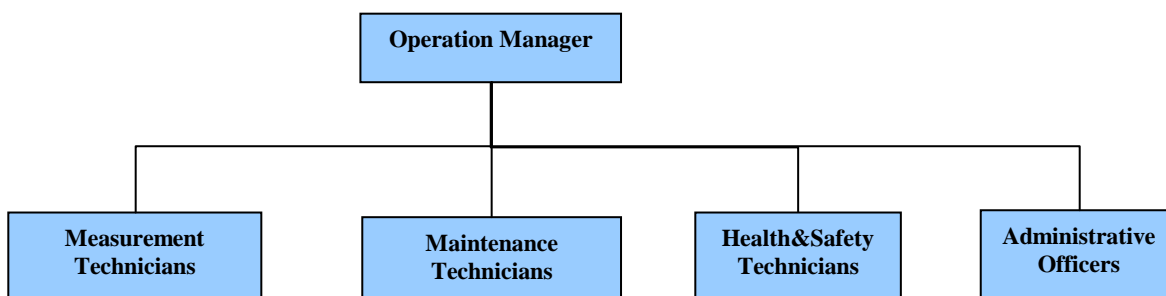


Table 17 Descriptions of Jobs and Responsibilities in Düzova WEPP

Job Name	Job Description	Graduation Level	Staff Quantity	Prescribed Trainings
Measurement Technician	Measuring the electricity generation through the proper methods and instruments. Data storing and reporting to Operational Manager and Grid Operator (TEIAS)	Technician high school (electricity division)	1 person/shift (1 shift/day)	Grid Operator's Trainings
Maintenance Technician	Making periodical and failure maintenances programmes and activities. Following and fulfilling the guarantee procedures.	Technician high school (electricity or mechanical division)	1 person/shift (1 shift/day)	Electrical and Mechanical Trainings by Equipment Supplier (has to be decided)
Health & Safety Technician	Fulfilling occupational safety and health necessities. Responding to Environmental issues. For the issues, provide the proper data flow between the company and the stakeholders. Reporting to Operational managers.	Technician high school	1 person/shift (1 shift/day)	Occupational safety and health trainings for Chamber of Mechanical Engineers. First aid trainings from Local Authority of the Ministry of Health.
Security Guard	Small local procurements and arrange daily transportation. Controlling and managing the safety guard's activities.	High school	1 person/shift (3 shifts/day)	Effective team work, Time management trainings from consultancy firms and associations.

ÜTOPYA will keep all the data needed for the calculation of emission reductions during the crediting period and until two years after the last issuance of GS VERs for Düzova WEPP.



Because of the data acquisition and management and quality assurance procedures that are anyway in place, no additional procedures have to be established for the monitoring plan. Dedicated emergency procedures are not provided, as there is no possibility of overstating emission reductions due to emergency cases.

B.8. Date of completion of the application of the baseline study and monitoring methodology and the name of the responsible person(s)/entity(ies):

Date of completion: 04 May 2011 (Version 08)

Name of entity determining the baseline: FutureCamp GmbH, Germany (project consultant)

Tel: +49 89 45 22 67-0

Fax: +49 89 45 22 67-11

Email: climate@future-camp.de

Contributor: Ütopya Elektrik Üretim Sanayi ve Tic. A.Ş.

FutureCamp is not a project participant.

**SECTION C. Duration of the project activity / crediting period****C.1. Duration of the project activity:****C.1.1. Starting date of the project activity:**

17/02/2009 (Date of contract with GE for the first 6 turbines with 15 MW installed capacity).

C.1.2. Expected operational lifetime of the project activity:

The expected lifetime of the Düzova Wind Power Plant project is 20 years⁴¹.

C.2. Choice of the crediting period and related information:**C.2.1. Renewable crediting period:**

A renewable crediting period has been selected for the project.

C.2.1.1. Starting date of the first crediting period:

11/08/2009 (start date of operation for the first 6 turbines with 15 MW installed capacity).

C.2.1.2. Length of the first crediting period:

The length of the first crediting period is 7 years, 0 months.

C.2.2. Fixed crediting period:

Fixed crediting period is not applicable.

C.2.2.1. Starting date:

Not Applicable.

C.2.2.2. Length:

Not Applicable.

⁴¹ See, <http://www.talentfactory.dk/en/tour/econ/oandm.htm>

**SECTION D. Environmental impacts****D.1. Documentation on the analysis of the environmental impacts, including transboundary impacts:**

The regional environmental authority confirmed with a certificate⁴² that an official Environmental Impact Assessment (EIA) is not required for the proposed project. The need for an EIA is checked by the regional authority on a project specific base taking into account a project specific information file and considering local conditions.

All potential environmental issues were discussed in detail on the stakeholder consultation and no objections or critical opinions were received. The evaluation of social and environmental indicators regarding the project is based on the Sustainable Development Assessment Matrix provided in the Local Stakeholder Consultation Report as well as on common sense regarding the wind power plant technology. This analysis confirmed no EIA is necessary. No negative or critical indicators were identified. The total score of the Sustainable Development Assessment Matrix is +5.

D.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

There have not been identified any significant environmental impacts of the project.

SECTION E. Stakeholders' comments**E.1. Brief description how comments by local stakeholders have been invited and compiled:**

The stakeholders were actively invited to the stakeholder consultation meeting by:

- Invitation letter;
- Invitation in the local newspaper;
- Invitation in the national newspaper;
- Invitation on Aşağıkırıklar Village Coffehouse.

The stakeholder meeting was held on 13th of February 2009 at Wedding Hall of Aşağıkırıklar Village, Bergama / İzmir. At the meeting besides project developers, there were six local volunteers of TEMA Foundation one of them was local representative, one local representative of Greenpeace, three representative of Aliğa Organized Industrial Region Administration (ALOSBİ), two representative of Bergama Trade Registry, and president of Turkish Woman Association, Bergama Branch. Mayor of Aşağıkırıklar Village and many participants from the village were there to participant to the meeting. The number of total participants was more than 200, however, 100 of them signed the participation list. Supporter of Gold Standard Organizations i.e. WWF, Greenpeace and REC Turkey has been informed about project.

The place of meeting was chosen to be the closest place to the project area and all local people are informed about meeting in advance by coffehouse, municipality announcements and local newspaper

⁴² Available to DOE during validation.



announcements. Additionally, one week before meeting village had been visited and announcement of upcoming meeting had been done. With an announcement in national newspaper there were two participants from Bergama Trade Registry and three participants from Aliğa Organized Industrial Region Administration who were interested in project.

Before presentation, agenda of the meeting and non-technical PDD was distributed to the participants for broader view. Project presentation and description was made including information about project developers, the technology and operation of the power plant, estimated emission reduction amount of the plant, the importance of revenue from emission reduction, information about Gold Standard and the project characteristics which makes this project different from other power plant projects in Turkey. Before passing to blind sustainable development exercise, question and comments were taken from participants about further clarification of project.

After clarification of the project with answering questions, he presented blind sustainable exercise to the participants and wanted them to comment on each indicator as positive, negative and neutral. After presentation some questions were raised by participants, which were answered by project coordinator Mr. Sancar Saraçoğlu and presenter. The questions and answers are given in '*ii. Assessment of comments*' section of LSC Report. All questions received and minutes of the meeting was taken under protocol signed by Major of Aşağıkırıklar Village Halil Erol and Project Coordinator Mr. Sancar Saraçoğlu. Questions and comments raised by participants were addressed in assessment of comments part.

The meeting was closed by a general support from participants and of project developer goodwill.

Detailed information regarding the stakeholder consultation and the stakeholders' comments is provided in the extra document Local Stakeholder Consultation (LSC) Report, which is also available to DOE.

E.2. Summary of the comments received:

17 original evaluation forms as well as translation version in English are attached in Annex 2 of the LSC Report.

The overall feedback to the organized consultation, and what follows to the project, has been very positive. The stakeholders consider the project environmental-friendly, which can provide clean energy, help the villages, and provide new employment possibilities in the region. Detail information regarding the stakeholders' feedback and comments is provided in the LSC Report.

The stakeholders didn't raise any concerns except some demands for local employment, and affects of project on crops. The concern of local employment was answered clearly by project coordinator as there will be priority to employ local people for project works. The request of villagers in written forms regarding loudspeaker system and graveyard hedge was read by presenter and accepted by project developer.

The comments and question regarding affect of project on crops raised in written forms and passed to us after meeting were explained during presentation as there will be no affect of project on crops. While project area is not an agricultural area, the affects of turbines which could be only in sense of shadowing, agricultural areas and crops which is located 100-200 meter away from project area would not be negatively affected.

All comments and questions from stakeholders were considered as serious and reasonable. An adequate answer has been provided. There have not been raised any critical comments nor objections for the project



implementation. Detailed table with all stakeholder comments and the responses is provided in the Section B.5 of Stakeholder Consultation Report.

E.3. Report on how due account was taken of any comments received:

The stakeholders have not raised any concerns, any important suggestions and negative opinion regarding the project, which may necessitate revisiting sustainability assessment. Concern of local employment and affects to the agricultural activities are evaluated and they are adequate answers have been provided. Since, the project area is plain without any agricultural activity there will be no negative effect. Also, project developer has stated his intention and sensitivity about local employment for this project. Therefore sustainable assessment is not going to be revisited as well as no alteration in project design will be done.

Annex 1**CONTACT INFORMATION ON PARTICIPANTS IN THE PROJECT ACTIVITY**

Organization:	Ütopya Elektrik Üretim Sanayi ve Tic. A.Ş.
Street/P.O.Box:	Hakkı Yeten Cad.
Building:	No: 10/C Kat: 6
City:	BEŞİKTAŞ-İSTANBUL
State/Region:	
Postfix/ZIP:	34357
Country:	Turkey
Telephone:	+90 212 2156060
FAX:	
E-Mail:	onur.yazgan@finaenerji.com
URL:	http://www.finaenerji.com.tr
Represented by:	Onur Yazgan
Title:	Mr.
Salutation:	Project Manager
Last Name:	Yazgan
Middle Name:	
First Name:	Onur
Department:	
Mobile:	
Direct FAX:	
Direct tel:	
Personal E-Mail:	onur.yazgan@finaenerji.com



Annex 2

INFORMATION REGARDING PUBLIC FUNDING

--- NOT APPLICABLE---

Annex 3

BASELINE INFORMATION

Calculation of Total CO₂ from OM Power Plants:

Table 18 HV_{i,y} (Heating Values for Fossil Fuels for Electricity Generation (Tcal)

Energy Sources	2006	2007	2008
Hard Coal+Imported Coal	29,504	32,115	33,310
Lignite	83,932	100,320	108,227
Fuel Oil	16,769	21,434	20,607
Diesel Oil	627	517	1,328
LPG	0	0	0
Naphta	141	118	113
Natural Gas	150,588	179,149	189,057

Table 19 FC_{i,y} (Fuel Consumptions for Fossil Fuels for Electricity Generation (million m³ for Natural Gas and ton for others)

Energy Sources	2006	2007	2008
Hard Coal+Imported Coal	5,617,863	6,029,143	6,270,008
Lignite	50,583,810	61,223,821	66,374,120
Fuel Oil	1,746,370	2,250,686	2,173,371
Diesel Oil	61,501	50,233	131,206
LPG	33	0	0
Naphta	13,453	11,441	10,606
Natural Gas	17,034,548	20,457,793	21,607,635

1 Tcal = 4.1868 TJ

Table 20 NCV_{i,y} (Average Net Calorific Values for Fossil Fuels for Electricity Generation (TJ/million m³ for Natural Gas and TJ/kt for others) and EF_i (Emission Factor of Fossil Fuels)

Energy Sources	NCVi 2006	NCVi 2007	NCVi 2008	EF _i
Hard Coal+Imported Coal	21.99	22.30	22.24	89.50
Lignite	6.95	6.86	6.83	90.90
Fuel Oil	40.20	39.87	39.70	72.60
Diesel Oil	42.68	43.09	42.38	72.60
LPG	0.00	0.00	0.00	61.60
Naphta	43.88	43.18	44.61	69.30
Natural Gas	37.01	36.66	36.63	54.30

Table 21 CO₂ Emission by each Fossil Fuels Types (ktCO₂e)

Energy Sources	2006	2007	2008
Hard Coal+Imported Coal	11,056	12,034	12,482
Lignite	31,943	38,180	41,189
Fuel Oil	5,097	6,515	6,264



Diesel Oil	191	157	404
Lpg	0	0	0
Naphta	41	34	33
Natural Gas	34,235	40,728	42,981
TOTAL	82,562	97,649	103,352

Identification of Sample Group

Table 22 Sample Group PPs for BM Emission Factor Calculation

Name of Power Plant	Capacity (MW)	Average Generation (GWh)	Fuel Type	Date of Operation
ANKARA D.G.(BAYMİNA) GR-I-II-III	798.0	6,500.0	N. Gas	08.01.2004
ENTEK GR-IV	31.1	255.7	N.GAS+NAPHTA	12.02.2004
ATATEKS 2 GM	5.6	45.0	N. Gas	20.02.2004
TANRIVERDİ 4 GM	4.7	38.7	N. Gas	24.03.2004
ÇOLAKOĞLUB(CAPACITY INCREMENT)	45.0	337.5	IMPORTED COAL	05.05.2004
TEKBOY TEKSTİL 1 GM	2.2	16.0	N. Gas	18.05.2004
GÜL ENERJİ GR-II	12.5	96.5	Fuel Oil	03.06.2004
KOMBASSAN KAĞIT GIDA VE TEKS	5.5	38.1	N. Gas	09.06.2004
AYEN OSTİM ENERJİ ÜRETİM	31.1	264.1	N. Gas	11.06.2004
BİS ENERJİ 2 GT	73.0	602.7	N. Gas	16.06.2004
ENERJİ-SA ADANA 1 BT	49.8	322.9	NAPHTA	23.06.2004
ŞAHİNLER ENERJİ 1 GM	3.2	22.2	N. Gas	29.06.2004
BESLER GR-2, BT (5,2+7,5)	12.7	97.7	N. Gas	07.07.2004
ÇELİK ENERJİ ÜR.ŞTİ. 2 GM	2.4	18.6	N. Gas	09.07.2004
KOMBASSAN KAĞ. MATBAA GIDA	5.5	35.7	N. Gas	24.09.2004
AYEN OSTİM ENERJİ ÜRETİM (BT)	9.9	84.0	N. Gas	01.10.2004
HABAŞ ALİAĞA GRUP I-II	89.2	713.9	N. Gas	08.10.2004
STANDART PROFİL 3 GM	6.7	49.2	N. Gas	22.10.2004
KARKEY-II 3+3 DGM	54.3	369.7	Fuel Oil	12.11.2004
ALTINMARKA GIDA GR I-II-III	3.6	28.8	N. Gas	17.12.2004
ERE (BİR KAPILI HES) GRUP-I	48.5	170.6	Hydro (Run of River)	11.03.2004
ELTA ELK (DODURGA) GR-I-II-III-IV	4.1	12.3	Hydro (Run of River)	26.04.2004
İSKUR TEKSTİL (SÜLEYMANLI) GR I-II	4.6	17.9	Hydro (Run of River)	28.04.2004
BEREKET EN. (Feslek Hes) Gr-1-2	9.5	41.0	Hydro (Run of River)	05.08.2004
ÇAN GR I	160.0	1,040.0	LIGNITE	15.02.2005
ÇAN GR II	160.0	1,040.0	LIGNITE	15.03.2005
ELBİSTAN-B GR I	360.0	2,340.0	LIGNITE	15.02.2005
AKBAŞLAR GR-II (Isolated)	8.8	73.0	N.GAS	24.06.2005
AKÇA ENERJİ GR-III	8.7	65.4	N.GAS+NAPHTHA	14.12.2005
AYKA TEKSTİL GR-I	5.5	40.0	N. Gas	24.09.2005
BAYDEMİRLER GR IV-V-VI	6.2	51.4	N. Gas	04.02.2005
BOSEN GR-III	50.0	350.0	N. Gas	30.12.2005



ÇUMRA ŞEKER	16.0	40.0	N.GAS+LIGNITE	01.01.2005
ETİ MAD.(BAN.ASİT)GR-I	11.5	85.0	RENEW.+WASTE S	15.07.2005
EVYAP GR I-II	5.1	30.0	N. Gas	27.08.2005
GRANİSER GRANİT GR-I	5.5	42.0	N. Gas	14.11.2005
HABAŞ ALİAĞA GR III	47.7	381.6	N. Gas	02.06.2005
HABAŞ ALİAĞA GR IV	47.7	381.6	N. Gas	21.09.2005
HABAŞ ALİAĞA GR-V	24.6	196.8	N. Gas	24.11.2005
HAYAT KAĞIT GR-I	7.5	56.0	N. Gas	27.05.2005
İÇDAŞ ÇELİK GR-I	135.0	1,080.0	IMPORTED COAL	30.11.2005
KAHRAMANMARAŞ KAĞIT GR-I	6.0	45.0	IMPORTED COAL	08.12.2005
KORUMA KLOR GR I-II-III	9.6	77.0	N. Gas	03.12.2005
KÜÇÜKÇALIK TEKSTİL GR I-II-III-IV	8.0	64.0	N. Gas	27.11.2005
MERCEDES BENZ TURK GR I-II-III-IV	8.3	68.0	N. Gas	04.02.2005
MODERN ENERJİ GR-III	8.4	62.9	N. Gas	14.06.2005
MODERN ENERJİ GR-II	6.7	50.4	N.GAS+LPG	14.06.2005
MOSB GR I-II-III-IV-V-VI-VII	84.8	434.0	N. Gas	01.03 - 01.08.2005
ORS RULMAN	12.4	99.4	N. Gas	25.08.2005
PAK GIDA (Kemalpaşa) GR-I	5.7	45.0	N. Gas	07.12.2005
TEZCAN GALVANİZ GR I-II	3.7	29.0	N. Gas	27.05.2005
YONGAPAN(KAST.ENTG) GR-II	5.2	32.7	N. Gas	25.05.2005
ZEYNEP GİYİM SAN. GR-I	1.2	9.0	N. Gas	07.07.2005
AK ENERJİ(K.paşa) GR- III	40.0	256.9	N. Gas	09.11.2005
AK ENERJİ(K.paşa) GR I-II	87.2	560.1	N. Gas	30.04.2005
ALTEK ALARKO GR I-II	60.1	420.0	N. Gas	14.10.2005
BİS ENERJİ GR VII	43.7	360.8	N. Gas	18.03.2005
CAN ENERJİ GR-I	3.9	28.0	N. Gas	25.08.2005
ÇEBİ ENERJİ BT	21.0	164.9	N. Gas	27.08.2005
ÇEBİ ENERJİ GT	43.4	340.1	N. Gas	23.08.2005
ENTEK ELK.A.Ş.KOÇ ÜNİ.GR I-II	2.3	19.0	N. Gas	07.02.2005
KAREGE GR IV-V	18.1	141.9	N. Gas	07.04.2005
KARKEY(SİLOPİ-4) GR-IV	6.2	47.2	Fuel Oil	30.06.2005
KARKEY(SİLOPİ-4) GR-V	6.8	51.9	Fuel Oil	23.12.2005
METEM ENERJİ(Hacışiramat) GR I-II	7.8	58.0	N. Gas	29.01.2005
METEM ENERJİ(Peliklik) GR I-II-III	11.7	89.0	N. Gas	29.01.2005
NOREN ENERJİ GR-I	8.7	70.0	N. Gas	24.08.2005
NUH ENERJİ-2 GR I	47.0	319.7	N. Gas	24.05.2005
ZORLU ENERJİ KAYSERİ GR-I-II-III	149.9	1,144.1	N. Gas	22.07.2005
ZORLU ENERJİ KAYSERİ GR-IV	38.6	294.9	N. Gas	26.10.2005
ZORLU ENERJİ YALOVA GR I-II	15.9	122.0	N. Gas	26.11.2005
TEKTUĞ(Kargılık) GR I-II	23.9	83.0	Hydro (Run of River)	25.04.2005
İÇTAŞ ENERJİ(Yukarı Mercan) GR I-II	14.2	44.0	Hydro (Run of River)	02.05.2005
MURATLI GR I-II	115.0	444.0	Hydro (with Dam)	03.06.2005
BEREKET EN.(DALAMAN) GR XIII-XIV-XV	7.5	35.8	Hydro (Run of River)	16.07.2005
YAMULA GRUP I-II	100.0	422.0	Hydro (with Dam)	31.07.2005
SUNJÜT(RES) GR I-II	1.2	2.4	Wind	23.04.2005
EKOTEN TEKSTİL GR-I	1.9	14	N. Gas	16.02.2006
ERAK GİYİM GR-I	1.4	10.0	N. Gas	22.02.2006



ALARKO ALTEK GR-III	21.9	173.0	Steam	23.02.2006
AYDIN ÖRME GR-I	7.5	60.0	N. Gas	25.02.2006
NUH ENERJİ-2 GR-II	26.1	180.1	Steam	02.03.2006
MARMARA ELEKTRİK (Çorlu) GR-I	8.7	63.0	N. Gas	13.04.2006
MARMARA PAMUK(Çorlu) GR-I	8.7	63.0	N. Gas	13.04.2006
ENTEK (Köseköy) GR-IV	47.6	378.2	N. Gas	14.04.2006
ELSE TEKSTİL (Çorlu) GRI-II	3.2	25.0	N. Gas	15.04.2006
SÖNMEZ ELEKTRİK (Çorlu) GRI-II	17.5	126.0	N. Gas	03.05.2006
MENDERES ELEKTRİK GR-I	8.0	56.0	Geothermal	10.05.2006
KASTAMONU ENTEGRE (Balıkesir) GR-I	7.5	54.0	N. Gas	24.05.2006
BOZ ENERJİ GR-I	8.7	70.0	N. Gas	09.06.2006
ADANA ATIK SU ARITMA TESİSİ	0.8	6.0	Biogas	09.06.2006
AMYLUM NİŞASTA (ADANA)	14.3	34.0	N. Gas	09.06.2006
ŞIKMAKAS (Çorlu) GR-I	1.6	13.0	N. Gas	22.06.2006
ELBİSTAN B GR-III	360.0	2,340.0	Lignite	23.06.2006
ANTALYA ENERJİ GR I-II-III-IV	34.9	245.0	N. Gas	29.06.2006
HAYAT TEM. VE SAĞLIK GR I-II	15.0	108.0	N. Gas	30.06.2006
EKOLOJİK EN. (Kemerburgaz) GR-I	1.0	6.0	Waste Heat	31.07.2006
EROĞLU GİYİM (Çorlu) GR-I	1.2	9.0	N. Gas	01.08.2006
CAM İŞ ELEKTRİK (Mersin) GR-I	126.1	1,008.0	N. Gas	13.09.2006
ELBİSTAN B GR-II	360.0	2,340.0	Lignite	17.09.2006
YILDIZ ENT. AĞAÇ (Kocaeli) GR-I	6.2	40.0	N. Gas	21.09.2006
ÇERKEZKÖY ENERJİ GR-I	49.2	390.0	N. Gas	06.10.2006
ENTEK (Köseköy) GR-V	37.0	293.9	N. Gas	03.11.2006
ITC-KA EN. MAMAK TOP.M. GR I-II-III	4.2	30.0	Waste Heat	03.11.2006
ELBİSTAN B GR-IV	360.0	2,340.0	Lignite	13.11.2006
ÇIRAĞAN SARAYI GR-I	1.3	11.0	N. Gas	01.12.2006
ERTÜRK ELEKTRİK Tepe RES GR-I	0.9	2.0	Wind	22.12.2006
AKMAYA (Lüleburgaz) GR-I	6.9	50.0	N. Gas	23.12.2006
BURGAZ (Lüleburgaz) GR-I	6.9	54.0	N. Gas	23.12.2006
ŞANLIURFA GR I-II	51.8	124.0	Hydro (Run of River)	01.03.2006
BEREKET ENERJİ GÖKYAR HES 3 Grup	11.6	43.3	Hydro (Run of River)	05.05.2006
MOLU EN. Zamantı Bahçelik GR I-II	4.2	16.7	Hydro (Run of River)	31.05.2006
SU ENERJİ (Balıkesir) GR I-II	4.6	20.7	Hydro (Run of River)	27.06.2006
BEREKET EN. (Mentaş Reg) GR I-II	26.6	108.7	Hydro (Run of River)	31.07.2006
EKİN (Başaran Hes) (Nazilli)	0.6	4.5	Hydro (Run of River)	11.08.2006
ERE (Sugözü rg. Kızıldüz hes) GR I-II	15.4	31.6	Hydro (Run of River)	08.09.2006
ERE (AKSU REG. Ve ŞAHMALLAR HES) GR I-II	14.0	26.7	Hydro (Run of River)	16.11.2006
TEKTUĞ (Kalealtı) GR I-II	15.0	52.0	Hydro (Run of River)	30.11.2006
BEREKET EN. (Mentaş Reg) GR III	13.3	54.4	Hydro (Run of River)	13.12.2006
HABAŞ (ALİAĞA-ADDITION)	9.1	35.3	N. Gas	02.05.2007
MODERN ENERJİ	5.2	38.0	N. Gas	2007
Acıbadem Sağlık Hiz.ve Tic.A.Ş(Kadıköy Hast.)	0.5	4.0	N. Gas	19.06.2007
Acıbadem Sağlık Hiz.ve Tic.A.Ş(Kozyatağı)	0.6	5.0	N. Gas	23.10.2007



Hast.)				
Acıbadem Sağlık Hiz.ve Tic.A.Ş.(Nilüfer/BURSA)	1.3	11.0	N. Gas	28.08.2007
AKATEKS Tekstil Sanayi ve Ticaret A.Ş.	1.8	14.0	N. Gas	30.07.2007
FLOKSER TEKSTİL SAN.AŞ.(Çatalca/İstanbul)	2.1	17.0	N. Gas	03.12.2007
FLOKSER TEKSTİL SAN.AŞ.(Çatalca/İstanbul)	2.1	17.0	N. Gas	03.12.2007
FRİTOLAY GIDA SAN.VE TİC. AŞ.	0.5	4.0	N. Gas	23.01.2007
KIVANÇ TEKSTİL SAN.ve TİC.A.Ş.	3.9	33.0	N. Gas	20.03.2007
KİL-SAN KİL SAN.VE TİC. A.Ş	3.2	25.0	N. Gas	19.02.2007
SÜPERBOY BOYA SAN.ve Tic.Ltd.Şti.	1.0	8.0	N. Gas	05.12.2007
SWİSS OTEL (Anadolu Japan Turizm A.Ş (İstanbul)	1.6	11.0	N. Gas	01.08.2007
TAV Esenboğa Yatırım Yapım ve İşetme AŞ.	3.9	33.0	N. Gas	19.09.2007
KARTONSAN	5.0	40.0	Liqued Fuel + N.Gas	2007
ESKİŞEHİR END. ENERJİ	3.5	26.8	Liqued Fuel + N.Gas	2007
İGSAŞ	2.2	15.2	Liqued Fuel + N.Gas	2007
ITC-KA Enerji Üretim Aş.(Mamak)(Addition)	1.4	11.0	Waste Heat	22.05.2007
BİS Enerji Üretim AŞ.(Bursa)(Addition)	43.0	354.8	N. Gas	30.05.2007
Aliağa Çakmaktepe Enerji A.Ş.(Aliağa/İZMİR)	34.8	278.0	N. Gas	13.09.2007
BİS Enerji Üretim AŞ.(Bursa)(Addition)	48.0	396.1	N. Gas	30.08.2007
BOSEN ENERJİ ELEKTRİK AŞ.	142.8	1,071.0.	N. Gas	18.01.2007
SAYENERJİ ELEKTRİK ÜRETİM AŞ. (Kayseri/OSB)	5.9	47.0	N. Gas	03.07.2007
T ENERJİ ÜRETİM AŞ.(İSTANBUL)	1.6	13.0	N. Gas	04.04.2007
ZORLU EN.Kayseri (1 GT Addition)	7.2	55.0	N. Gas	17.01.2007
SİİRT	25.6	190.0	Fuel Oil	2007
Mardin Kızıltepe	34.1	250.0	Fuel Oil	2007
KAREN	24.3	180.0	Fuel Oil	2007
İDİL 2 (PS3 A- 2)	24.4	180.0	Fuel Oil	2007
BORÇKA HES	300.6	1,039.0.	Hydro (With Dam)	27.02.2007
TEKTUĞ(Keban River)	5.0	32.0	Hydro (run of river)	08.05.2007
YPM Ener.Yat.AŞ.(Altintepe Hydro)	4.0	18.0	Hydro (run of river)	06.06.2007
YPM Ener.Yat.AŞ.(Beypınar Hydro)	3.6	18.0	Hydro (run of river)	06.06.2007
YPM Ener.Yat.AŞ.(Konak Hydro)	4.0	19.0	Hydro (run of river)	19.07.2007
KARASU HES-Andırın	2.4	19.0	Hydro (run of river)	28.11.2007
İSKUR TEKSTİL (SÜLEYMANLI HES)	4.6	18.0	Hydro (run of river)	30.12.2007
ÖZGÜR ELK.AŞ.(K.MARAŞ)(Tahta)	6.3	27.0	Hydro (run of river)	03.05.2007
ÖZGÜR ELK.AŞ.(K.MARAŞ)(Tahta)(Addition)	6.3	27.0	Hydro (run of river)	24.05.2007
MB ŞEKER NIŞASTA SAN.A.Ş. (Sultanhanı)	8.8	60.0	Natural Gas	2008
AKSA ENERJİ (Antalya)	183.8	1,290.0	Natural Gas	2008
AKSA ENERJİ (Manisa)	52.4	370.0	Natural Gas	2008
ANTALYA ENERJİ (Addition)	17.5	122.3	Natural Gas	2008



ATAÇ İNŞAAT SAN. A.S.B. (ANTALYA)	5.4	37.0	Natural Gas	2008
BAHÇIVAN GIDA (LÜLEBURGAZ)	1.2	8.0	Natural Gas	2008
CAN ENERJİ (Çorlu - Tekirdağ) (Addition)	52.4	304.2	Natural Gas	2008
FOUR SEASONS OTEL (ATİK PASHA TUR. A.Ş.)	1.2	7.0	Natural Gas	2008
FRİTOLAY GIDA SAN.VE TİC. AŞ. (Addition)	0.1	4.0	Natural Gas	2008
ITC-KA Enerji Üretim Aş.(Mamak)(Addition)	14.1	95.8	Waste	2008
KARKEY (SİLOPİ-5) (154 kV) (Addition)	14.8	103.2	Fuel Oil	2008
MELİKE TEKSTİL (GAZİANTEP)	1.6	11.0	Natural Gas	2008
MİSİS APRE TEKSTİL BOYA EN. SAN.	2.0	14.0	Natural Gas	2008
MODERN ENERJİ (LÜLEBURGAZ)	13.4	94.1	Natural Gas	2008
ORTADOĞU ENERJİ (ODA YERİ) (Eyüp/İST.)	2.8	22.0	Waste	2008
POLAT TURZ. (POLAT RENAISSANCE İST. OT.)	1.6	11.0	Natural Gas	2008
SARAYKÖY JEOTERMAL (Denizli)	6.9	50.0	Geothermal	2008
SÖNMEZ Elektrik (Addition)	8.7	67.3	Natural Gas	2008
AKKÖY ENERJİ (AKKÖY I HES)	101.9	408.0	Hydro (with Dam)	2008
ALP ELEKTRİK (TINAZTEPE) ANTALYA	7.7	29.0	Hydro (run of river)	2008
CANSU ELEKTRİK (MURGUL/ARTVİN)	9.2	47.0	Hydro (run of river)	2008
ÇALDERE ELEKT. (ÇALDERE HES) Dalaman - MUĞLA	8.7	35.0	Hydro (run of river)	2008
DAREN HES ELKT. (SEYRANTEPE BARAJI VE HES)	49.7	182.0	Hydro (With Dam)	2008
DEĞİRMENÜSTÜ EN. (KAHRAMANMARAŞ)	25.7	69.0	Hydro (With Dam)	2008
GÖZEDE HES (TEMSA ELEKTRİK) BURSA	2.4	10.0	Hydro (run of river)	2008
H.G.M ENERJİ (KEKLİCEK HES) (Yeşilyurt)	8.7	18.0	Hydro (run of river)	2008
HAMZALI HES (TURKON MNG ELEKTRİK)	16.7	117.0	Hydro (run of river)	2008
HİDRO KNT. (YUKARI MANAHOZ REG. VE HES)	22.4	79.0	Hydro (run of river)	2008
İÇ-EN ELK. (ÇALKIŞLA REGÜLATÖRÜ VE HES)	7.7	18.0	Hydro (run of river)	2008
KALEN ENERJİ (KALEN II REGÜLAT. VE HES)	15.7	50.0	Hydro (run of river)	2008
MARAŞ ENERJİ (FIRNIS REGÜLATÖRÜ VE HES)	7.2	36.0	Hydro (run of river)	2008
SARMAŞIK I HES (FETAŞ FETHİYE ENERJİ)	21.0	96.0	Hydro (run of river)	2008
SARMAŞIK II HES (FETAŞ FETHİYE ENERJİ)	21.6	108.0	Hydro (run of river)	2008
TORUL	105.6	322.0	Hydro (With Dam)	2008
YEŞİL ENERJİ ELEKTRİK (TAYFUN HES)	0.8	5.0	Hydro (run of river)	2008
TOTAL	6,718.6	43,962.3		



Annex 4

MONITORING INFORMATION

No additional information other than given in B.7