



**Verified Carbon
Standard**

DÜZCE-AKSU HYDRO ELECTRICITY POWER PLANT

Document Prepared by GTE KARBON SÜRDÜRÜLEBİLİR ENERJİ
EĞİTİM DANIŞMANLIK VE TİC. A.Ş.

Project Title	Düzce-Aksu Hydro Electricity Power Plant
Version	2.04
Report ID	DÜZCEAKSU VCSMR-02
Date of Issue	19/10/2022
Project ID	VCS2095
Monitoring Period	01-October-2020 to 31-December-2021
Prepared By	GTE KARBON SÜRDÜRÜLEBİLİR ENERJİ EĞİTİM DANIŞMANLIK VE TİC. AŞ (Project Developer)
Contact	Mustafa Kemal Mah. 2118. Cad. No: 4 C Blok 42 06510 Çankaya, Ankara - Turkey +90 312 514 63 63 kemal.demirkol@gte.com.tr https://www.gte.com.tr/

CONTENTS

1	PROJECT DETAILS.....	3
1.1	Summary Description of the Implementation Status of the Project	3
1.2	Sectoral Scope and Project Type	4
1.3	Project Proponent	4
1.4	Other Entities Involved in the Project	5
1.5	Project Start Date	5
1.6	Project Crediting Period	5
1.7	Project Location	5
1.8	Title and Reference of Methodology	6
1.9	Participation under other GHG Programs.....	6
1.10	Other Forms of Credit.....	7
1.11	Sustainable Development Contributions	7
2	SAFEGUARDS	10
2.1	No Net Harm	10
2.2	Local Stakeholder Consultation	
2.3	AFOLU-Specific Safeguards	11
3	IMPLEMENTATION STATUS	11
3.1	Implementation Status of the Project Activity	11
3.2	Deviations	11
3.3	Grouped Projects	12
4	DATA AND PARAMETERS.....	12
4.1	Data and Parameters Available at Validation	12
4.2	Data and Parameters Monitored.....	12
4.3	Monitoring Plan.....	16
5	QUANTIFICATION OF GHG EMISSION REDUCTIONS AND REMOVALS	20
5.1	Baseline Emissions	
5.2	Project Emissions	20
5.3	Leakage.....	21
5.4	Net GHG Emission Reductions and Removals.....	21
	APPENDIX X: <TITLE OF APPENDIX>	24

1 PROJECT DETAILS

1.1 Summary Description of the Implementation Status of the Project

Düzce-Aksu Elektrik Üretim A.Ş. constructed Düzce-Aksu Regulator and Hydro Electricity Power Plant (HEPP) on the Aksu River, that is a branch of the Büyük Melen River, within the jurisdiction of Gölyaka Town of Düzce Province. The purpose of the project is electricity production using the potential energy of Aksu River as a renewable resource.

Therefore, the electricity is produced without causing airborne pollutants or Green House Gas (GHG) emissions. The construction and operation of the Düzce-Aksu Hydro Electric Power Plant (HEPP) delays the addition of conventional thermal power plants to the Turkish National Electricity Grid.

The Project Activity (PA) utilizes the Aksu River to generate electricity with zero carbon emissions for the Turkish Power Grid. Düzce-Aksu HEPP is a run-off river reservoir as per EPDK license with a number of EÜ/8909-3/04348 and a date of 24/10/2019, which has a total installed capacity of 46.2 MWe (48,304 MWh) with two turbines each having a capacity of 23,10 MWe. The PA is displacing electricity that would otherwise be generated by the existing grid of the host country. The net electricity production by the PA is calculated as 97,222 MWh. and the Project Activity led to an emission reduction of 51,842 tons CO₂e for this monitoring period (01-October-2020 to 31-December-2021).

Table 1. Milestones

Date	Milestone
24/10/19	Project License Granted by EMRA
20/03/2020	Connection agreement signed between Düzce-Aksu and TEIAS
23/03/2020	System Use Agreement
13/02/07	Project was granted EIA not needed certification
22/07/2020	Water usage agreement signed between DSI and Düzce-Aksu A.Ş.
25/04/14	Commissioning date of Turbine 1 and Turbine 2

The Düzce-Aksu HEPP is going to be made up of one regulating body, a sedimentation pond, a water conveyance tunnel, a head pond, a valve chamber, penstock, power plant, tail water canal and the switchgear area. The generation voltage is 10,5 kV and the produced electricity is fed to the Turkish National Power Grid via one of the Transformer Substations by 23 km long 154 kV transmission line at the Düzce-Aksu HES Transfer Station¹.

The water is entering the weir body and the water collecting area over the Aksu River at the 790.50 m elevation level. The water is then settled in the sedimentation pond before being transferred to the

¹ System Use Agreement

conveyance tunnel. The water that passes through this tunnel is then transferred to the head pond where it is fed to the penstock and is passed to the hydro power plant building where the electricity is produced via turbines. The water then is left back in the Aksu River at the 138.2 m elevation level. How the project activity operates is shown below in Figure 1.

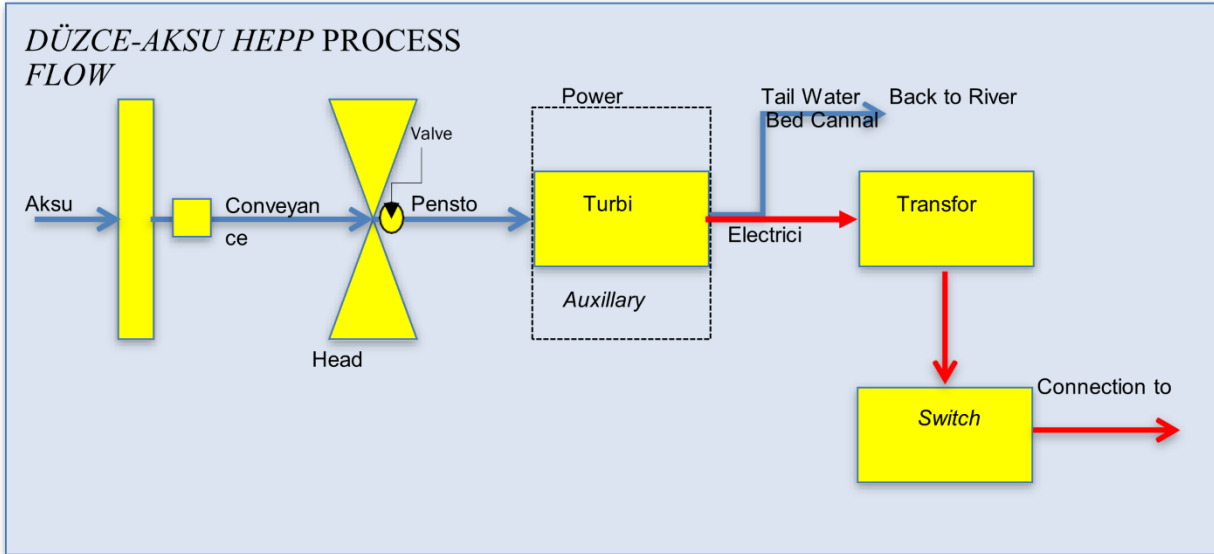


Figure 1: Flow chart showing the basic operational principles of the project activity.

The project activity is connected to the grid via the 154 KV Osmanca Transformation Center, as indicated in the connection agreement provided. The project start period is 25/04/2014 and the project has been operational since that day including the monitoring period of 01-October-2020 to 31-December-2021. How the project activity operates is as shown below in Figure 1

There are three generator units in the plant which are AKSA brand and APD 40 A, APD 125 A and APD 200 C types. The APD 40 A type generator has 40 kVA voltage, and the standby power is 32 kW. The APD 125 A type generator has 125 kVA voltage, and the standby power is 100 kW. The APD 200 C type generator has 200 kVA voltage, and the standby power is 160 kW.

1.2 Sectoral Scope and Project Type

The project category is Sectoral Scope 1: Energy industries (renewable-/non -renewable sources). The project is a non-grouped, stand-alone project.

1.3 Project Proponent

Organization name	Aydem Yenilenebilir Enerji A.S. 2
Contact person	Özgün Gül Koparan
Title	Environmental Affairs Manager

Address	Adalet Mahallesi Hasan Gönüllü Bulvarı No:15/1 Merkezefendi / Denizli-Turkey
Telephone	+90 258 242 27 76
Email	ozgun.gulkoparan@aydemenerji.com.tr

1.4 Other Entities Involved in the Project

Organization name	GTE Karbon Sürdürülebilir Enerji Eğitim Danışmanlık Ve Ticaret A.Ş.
Contact person	M. Kemal DEMİRKOL
Title	Director
Address	MAIDAN - Mustafa Kemal Mah. 2118. Cad. No: 4 C Blok 42 06510 Çankaya - Ankara – TURKEY
Telephone	+90 312 514 63 63
Email	kemal.demirkol@gte.com.tr

1.5 Project Start Date

25.04.2014 is the date when the project started to supply electricity to the Turkish grid as substantiated by the partial acceptance letter sent to the Governance of Düzce Province, Düzce-Turkey.

1.6 Project Crediting Period

The project crediting period is 10 years: 25.04.2014 to 23.04.2024 (both days inclusive). Renewable twice.

1.7 Project Location

The project is located at the Western Part of the Northern Black Sea geographical district of Turkey at the Düzce Province as shown in the location Map below (Figure 2). The nearest settlement to the project site is Gölyaka that can be reached using the major İstanbul Ankara Motorway, along the route towards Ankara Gölyaka is situated 11 km's after the Düzce province. The coordinates of the weir and the powerhouse are indicated in the below table (Table 2).

Table 2. The geographical coordinates indicating the location of the major components of the project activity:

Component's name	Latitude	Longitude
------------------	----------	-----------

Weir	40° 42'8.07"N	30° 57'49.93"E
Powerhouse	40° 45'39.31"N	30° 59'20.59"E

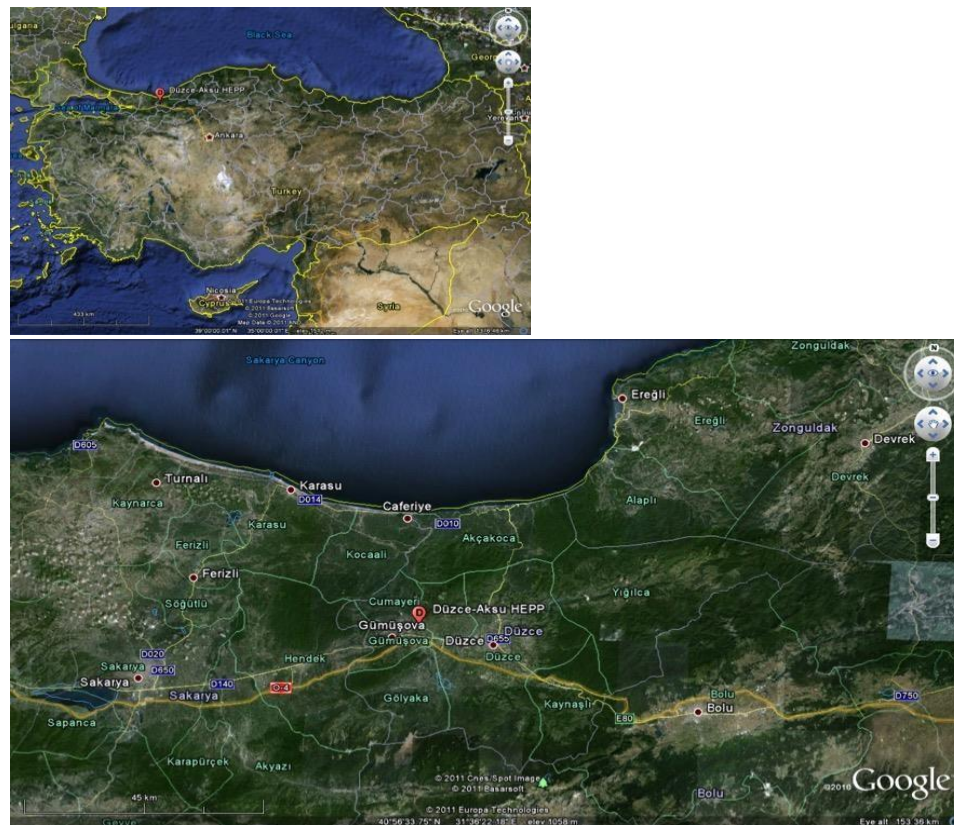


Figure 2: Project Location.

1.8 Title and Reference of Methodology

The following UNFFCC methodology and its related tools are utilized:

Approved consolidated baseline and monitoring methodology ACM0002 “Consolidated baseline methodology for grid-connected electricity generation from renewable sources.” Version 16.0.0.

The Approved Methodology refers to the following tools:

- “Tool for the demonstration and assessment of additionality” (Version 07.0)
- “Tool to calculate the emission factor for an electricity system”. (Version 05.0)
- "Tool to calculate project or leakage CO2 emissions from fossil fuel combustion" (Version 02)
- “Combined tool to identify the baseline scenario and demonstrate additionality” (Version 6.0.0).

Only the following tools are utilized:

- “Tool for the demonstration and assessment of additionality” (Version 07.0.0)

- “Tool to calculate the emission factor for an electricity system”. (Version 05.0.0)

Also, these tools are referred to in this PDD

- “Tool to determine the remaining lifetime of equipment” (Version 01)
- Tool to determine Common practice (Version 03.1)
- Methodological tool: Investment analysis (Version 06.0)

1.9 Participation under other GHG Programs

Not applicable

Emission Trading Programs and Other Binding Limits: The project reduces GHG emissions from activities that are not included in an emissions trading program or any other mechanism that includes GHG allowance trading, therefore the net GHG emission reductions or removals generated during this monitoring period are not to be used for compliance under such programs or mechanisms. The host country does not have binding emissions limits and the project is not eligible to produce any compliance emissions reductions.

Other Forms of Environmental Credit: The project has not sought or has not received another form of GHG-related environmental credit, including renewable energy certificates, during this monitoring period. Additionally, the project activity is not eligible to create another form of GHG-related environment credit.

Participation under Other GHG Programs: The project is not registered under any other GHG programs and, the project activity does not have any GHG credits claimed under such programs.

1.10 Other Forms of Credit

Not applicable

Host country does not have an emissions trading scheme and the project activity is not taking place in any other form of environmental credit.

Other Forms of Environmental Credit: The project has not sought or received any other form of GHG-related environmental credit, including renewable energy certificates, during this monitoring period.

1.11 Sustainable Development Contributions

The purpose of the project is electricity production using the potential energy of Aksu River as a renewable resource. Therefore, the electricity is going to be produced without causing airborne pollutants or Green House Gas (GHG) emissions. The construction and operation of the Düzce- Aksu Hydro Electric Power Plant (HEPP) is delaying the addition of conventional thermal power plants to the Turkish National Electricity Grid.

The project produces an average total of 97,222 MWh of electricity per year. The project is a green field project and in the absence of the project activity an equivalent amount of electricity would have been generated in the fossil fuel based national grid.

The following is a list of the project's contribution to the UN SDG:

- SDG 7 on access to affordable, reliable, and sustainable energy, as the project is not relying on imported fossil fuels.
- SDG-8 decent work and economic growth. As the project is providing a decent and secure work environment.
- SDG 13 on urgent action to combat climate change, as the project is replacing the fossil fuel based national grid and it is producing emission reductions.

Table 3: Sustainable Development Contributions

Row number	SDG Target	SDG Indicator	Net Impact on SDG Indicator	Current Project Contributions	Contributions Over Project Lifetime
1)	13.3	Tons of greenhouse gas emissions avoided	Implemented activities to increase	By generating electricity from clean sources, project has prevented 51,842 tCO2 into the atmosphere during the monitoring period	By generating electricity from clean sources, project has prevented 382,881 tCO2 into the atmosphere Over Project Lifetime.
2)	8.5	Job opportunities created	Implemented activities to increase	During the monitoring period 1 employees were recruited.	- Total 19 people were employed during over project lifetime.
3)	7.2	7.2.1 Renewable energy share in the total final energy consumption	Implemented activities to increase	The project generated 97,222 MWh electricity from hydropower which is a renewable source during the monitoring period	The project generated 718,047.67 MWh electricity from hydropower which is a renewable source over project lifetime

2 SAFEGUARDS

2.1 No Net Harm

During the project design phase, the following measures are undertaken in order to minimize the impacts during operational periods:

Water & Wastewater Management

Water for domestic use is supplied by tankers to the site and wastewater is collected in septic tanks which is emptied regularly. The wastewater is discharged in accordance with Water Pollution Control regulations of the host country.

Waste Oil

The waste oil is collected in impermeable containers and transferred to recycling centers in accordance with Hazardous Waste Control Regulations and Waste Oil Control Regulations. A photograph of the hazardous waste storage area is provided.

Collection records are provided dated 24/02/2021, 06/09/2021, 04/11/2021. These records include collection of hazardous wastes generated at the site.

Solid Waste

Solid waste is collected, and recyclables are separated to be sent to recycling centers. The rest is disposed to the nearest landfill site in coordination with Dereli District Municipality. The solid waste here also covers the E-Waste. Hence the disposal is realized in accordance with Regulation on Waste Management, Regulation on Electrical and Electronic Waste Control, and Regulation on Battery and Accumulator Wastes.

Collection records are provided dated 16/11/2021, 24/02/2021, 06/09/2021, 04/11/2021.

Biodiversity

Necessary precautions are taken for the species under conservation by international conventions, The field is regularly observed in terms of any change and irregularity of the biodiversity. Regular ecosystem reporting mechanism is applied for the field.

2.2 Local Stakeholder Consultation

The relationship with the local stakeholders deemed to be very important and before the project was implemented a stakeholder's consultation meeting was held at the project site. In addition to this there is a "grievance logbook" in the mosque and mukhtar's office within the vicinity of the project (Taşlık Village) for a continuous grievance policy that is implemented by the project owner.

Every month the PP consults with local stakeholders at the book locations and discuss their grievances as well as positive comments. During the monitoring period there were no complaints about or demands from the project.

2.3 AFOLU-Specific Safeguards

The Project is a non-AFOLU project.

3 IMPLEMENTATION STATUS

3.1 Implementation Status of the Project Activity

The construction of Düzce Aksu HPP has started in 16.11.2009. Düzce Aksu HPP consists of 2 units. Both units were commissioned in 25.04.2014, which is also the start date of the project. No major shutdown was observed during the monitoring period. Some minor failures in electricity generation have occurred due to drought and maintenance activities. Meters are checked and controlled everyday by the Operational Team (see Table 3). Also, the data from these metering devices are recorded by TEIAS on monthly agreed protocols. Necessary tests were carried out regularly in the metering devices during the monitoring period and no problems were encountered.

Since the start date of the project, there is no special event that may have impact on monitoring of GHG emission reductions.

3.2 Deviations

3.2.1 Methodology Deviations

The UNFCCC methodology of ACM0002 (version 16.0.0) and its related tools are applied as they are without any deviation from methodology.

3.2.2 Project Description Deviations

For the Project Proponent part, Bereket Energy was the major shareholder of Düzce Aksu Üretim A.Ş. and as the Bereket changed title as a company policy they have dissolved all the individual sister companies that hold licenses of facilities (like the Düzce Aksu HPP) ² and changed the ownership as Aydem Yenilenebilir A.Ş on 24/12/2019 as stated in official gazette with registration number of 13798³.

² EPDK License

³ Official Gazette with registration number of 13798

The project activity is in compliance with the scenario described at the Project Design Document. After EPIAŞ received Market Operating License on 01/09/2015, market operations were transferred from PMUM to EPIAŞ.

According to the revised agreement between TEİAŞ & PP i.e., Annex-3, Article 3.3 of “The Transmission System Usage Agreement dated 23/03/2020”, it has been found that the testing of energy meters will be carried out every 2 years. This will be applicable from the date of replacement of new meters i.e. from 13/06/2021.

The reservoir surface area (Apj) was indicated as 708,202 m² in both PD version 2.03 and MR version 1.03. However, this value was an error due to the character language i.e. “,” and “.”. The real value was 708.282 m² (i.e. 708.3 m²) as per the technical drawing provided in Appendix-3. The error was corrected by the project proponent in this monitoring period and new Apj was determined to be 707 m² for the current monitoring period (01-October-2020 to 31-December-2021) as per the lake surface area map provided in Appendix-2.

3.3 Grouped Projects

The project is not a grouped project activity.

4 DATA AND PARAMETERS

4.1 Data and Parameters Available at Validation

Data / Parameter	$FC_{i,y}$
Data unit	Mass or Volume Unit (Tons or cubic meter)
Description	Amount of fuel i consumed by relevant power plants in Turkey in years, 2009, 2010, 2011
Source of data	Turkish Electricity Transmission Company (TEİAŞ) Web Site https://www.teias.gov.tr/tr-TR/turkiye-elektrik-uretim-iletim-istatistikleri
Value applied	Please see Appendix 2 (Table 1) in the validated PD (version 2.03)
Justification of choice of data or description of measurement methods and procedures applied	Data used is taken from the TEİAŞ website, which is the website of the Turkish Electricity Distribution Company. The data published on the TEİAŞ website is the most up-to date and reliable data available for the Turkish grid.
Purpose of Data	Data used for the calculation of $EF_{grid,OM,Simple,y}$
Comments	

Data / Parameter	NCV
Data unit	GJ/Mass or Volume Unit

Description	Net Calorific Values for fossil fuels in years 2009, 2010 and 2011
Source of data	Turkish Electricity Transmission Company Web Site: https://www.teias.gov.tr/tr-TR/turkiye-elektrik-uretim-iletim-istatistikleri
Value applied	Please see Appendix-2 –Table 5 in the validated PD (version 2.03).
Justification of choice of data or description of measurement methods and procedures applied	Data used is taken from the TEİAŞ website, which is the website of the Turkish Electricity Distribution Company. The data published on the TEİAŞ website is the most up-to date and reliable data available for the Turkish grid.
Purpose of Data	Data used for the calculation of $EF_{grid, OM, Simple, y}$. As data on the NCV is not published directly on the TEİAŞ website, this data is calculated using the heating values of fuels and the volume or mass of fuels consumed for each year.
Comments	

Data / Parameter	$EF_{CO_2, i, y}$
Data unit	tCO ₂ /GJ
Description	CO ₂ emission factor of fossil fuel type <i>i</i> in year <i>y</i>
Source of data	IPCC default values at the lower limit of the uncertainty at a 95% confidence interval as provided in table 1.4 of Chapter1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG Inventories
Value applied	Please see Appendix 2-Table 2 in the validated PD (version 2.03)
Justification of choice of data or description of measurement methods and procedures applied	According to the “Tool to calculate the emission factor for an electricity system” version 2, if values provided by the fuel supplier of the power plants in invoices or regional or national average defaults values are not available the IPCC default values at the lower limit of uncertainty must be used.
Purpose of Data	Data used both for the calculation of $EF_{grid, OM, Simple, y}$ and $EF_{EL, m, y}$
Comments	

Data / Parameter	EG_y
Data unit	MWh
Description	Net electricity generated in the project electricity system in other words, net electricity generated and delivered to the grid by all power sources serving the system, not

	including low-cost - must-run power plants - units, in year y
Source of data	Turkish Electricity Transmission Company Web Site
Value applied	Please see Appendix 2, Table 3, and Table 4 in the validated PD (version 2.03).
Justification of choice of data or description of measurement methods and procedures applied	Data used is taken from the TEİAŞ website, which is the website of the Turkish Electricity Distribution Company. The data published on the TEİAŞ website is the most up-to-date and reliable data available for the Turkish grid.
Purpose of Data	Data used for the calculation of $EF_{grid, OM, Simple, y}$
Comments	

Data / Parameter	$EG_{m, y}$
Data unit	MWh
Description	Net quantity of electricity generated and delivered to the grid by power unit m in year y
Source of data	Turkish Electricity Transmission Company Web Site (https://www.teias.gov.tr/tr-TR/turkiye-elektrik-uretim-iletim-istatistikleri). Data is extracted from the relevant annexes of the capacity projection reports for the years 2010 ⁴ , 2011 ⁵ and 2012 ⁶ .
Value applied	Please see Appendix-2-Table 8 in the validated PD version 2.03
Justification of choice of data or description of measurement methods and procedures applied	Data used is taken from the TEİAŞ website, which is the website of the Turkish Electricity Distribution Company. The data published on the TEİAŞ website is the most up-to-date and reliable data available for the Turkish grid.
Purpose of Data	Data used for the calculation of $EF_{grid, BM, y}$
Comments	

Data / Parameter	$\eta_{m, y}$
Data unit	-
Description	Average net energy conversion efficiency of power unit m in year y
Source of data	The default values provided at the Annex 1 of the "Tool to calculate emission factor for an electricity system (Version 5.0, EB87Annex 9)" are used
Value applied	Please see Annex 2 in the validated PD version 2.03.

⁴ <http://www.teias.gov.tr/projeksiyon/KAPASITE%20PROJEKSIYONU%202010.pdf>

⁵ <http://www.teias.gov.tr/projeksiyon/KAPASITEPROJEKSIYONU2011.pdf>

⁶ <http://www.teias.gov.tr/KAPASITEPROJEKSIYONU2012.pdf>

Justification of choice of data or description of measurement methods and procedures applied	According to the “tool to calculate emission factor for an electricity specifications or data from the utility, the dispatch center or official records are not available then the default values given in Annex 1 of the shall be used. The first two options are not available for the power plants supplying the Turkish grid; therefore, the default values are used.
Purpose of Data	Data used for the calculation of $EF_{grid,BM,y}$
Comments	

4.2 Data and Parameters Monitored

Data / Parameter	EG _y
Data unit	MWh
Description	Quantity of net electricity generation supplied by the project plant to the grid in MP
Source of data	Electricity Meters
Description of measurement methods and procedures to be applied	Data is measured directly from meters and records on TEIAS readings protocol papers.
Frequency of monitoring/recording	Annually
Value monitored	The value is determined at the monitoring stage as 97,222 MWh
Monitoring equipment	Data is monitored continuously by redundant metering devices. The recording meter is in compliance with the communiqué for Metering Devices to be used in the Electricity Market. By regulation, the accuracy class is 0.2% Main Electricity Meter: ITRON, Serial Number: 65000766 Back-up Electricity Meter: ITRON, Serial Number: 65000767 Both meters are in compliance with the communiqué for Metering Devices to be used in the Electricity Market ⁸ . They have an accuracy class of Class 002 indicating an accuracy range of 0.2%.
QA/QC procedures to be applied	There are two meters that backup each other. Generated electricity is also monitored via the operator by the help of EPIAŞ trading software for internal monitoring. The Calibration dates of the meters and their validity is as follows:

		Main Meter	Spare Meter	Current Main Meter (Replaced on 13/06/2021)	Current Spare Meter (Replaced on 13/06/2021)
	Serial no.	65000766	65000767	10172379	10172380
	Brand- (Type)	ITRON (SL761B071)	ITRON (SL761B071)	EMH	EMH
	Calibration date	2011	2011	13/06/2021	13/06/2021
	Calibration due date	NA	NA	13/06/2031 ⁷	13/06/2031 ⁸
	Calibration frequency	10 years	10 years	10 years	10 years
	Test Due Date	NA	NA	13/06/2023	13/06/2023
	Test frequency	NA	NA	2 years	2 years
	Class	0.5S	0.5S	0.2S	0.2S
Purpose of the data	Data to be used for the calculation of Baseline Emissions.				
Calculation method	Direct Continuous Measurement				
Comments	The collected data is kept by Düzce Aksu Elektrik Üretim A.Ş. During the crediting period and until two years after the last issuance of VERs for the “Düzce-Aksu Hydro Electricity Power Plant” project activity for that crediting period.				

Data / Parameter	Cap _{PJ}
Data unit	W
Description	Installed capacity of the hydropower plants after the implementation of the Project Activity.
Source of data	Measured
Description of measurement methods and procedures to be applied	Project site computers with SCADA system and the turbine name plates.
Frequency of monitoring/recording	Observed via the SCADA system of the Project Activity
Value monitored	Once for each monitoring period

⁷ <https://www.mevzuat.gov.tr/mevzuat?MevzuatNo=6381&MevzuatTur=7&MevzuatTertip=5>
⁸ <https://www.mevzuat.gov.tr/mevzuat?MevzuatNo=6381&MevzuatTur=7&MevzuatTertip=5>

Monitoring equipment	46,200,000
QA/QC procedures to be applied	SCADA system of the Project Activity
Purpose of the data	Can be confirmed also by the parameter readings on the design plates of each turbine and by summing the two units.
Calculation method	N/A
Comments	-

Data / Parameter:	A _{PJ}
Data unit:	m ²
Description:	Area of the reservoir measured in the surface of the water, after the implementation of the Project Activity, when the reservoir is at its maximum fullness.
Measured /Calculated /Default:	Indirectly measured based on the reservoir area map provided in Appendix-2.
Source of data:	Surface area determined using the lake surface area map provided in Appendix-2.
Description of measurement methods and procedures to be applied:	The reservoir area corresponding to maximum operational level has been determined via the topographic satellite images showing the lake area, presented in Appendix-2.
Frequency of monitoring/recording:	Once during each monitoring period
Value applied:	707 m ²
Monitoring equipment:	-
QA/QC procedures to be applied:	The value checked and compared to satellite imagery available by Google Earth.
Purpose of the data:	Data to be used for the calculation of Baseline Emissions.
Calculation method:	N/A
Any comment:	-

4.3 Monitoring Plan

Objectives of the monitoring program

The Monitoring plan is developed to ensure that the Project Activity is well organized from the start in terms of the collection and archiving of complete and reliable data that is needed to ensure reliable and accurate measurements of actual emission reductions.

Data to be monitored

Given that the emission factor is calculated on an ex-ante basis, the first data to be monitored is the net electricity supplied to the grid.

The second data to be monitored is the installed capacity of the Project Activity. Using the SCADA system installed capacity is measured automatically.

The third data to be monitored is the reservoir area of the Project Activity. The reservoir area corresponding to maximum operational level has been determined as a certain value according to the topographical maps. In order to make verification of the reservoir area, the reservoir lake is compared to the reservoir area map, presented in Appendix 2.

The electricity produced is sold to TEİAŞ. Therefore, TEİAŞ measures the electricity produced by two meters placed on the switchgear station where the power plant gets connected to the Turkish national grid. Those meters provide official data which is read and recorded monthly by TEİAŞ officers for invoicing. TEİAŞ also conducts the calibration and maintenance of these meters and thus, ensures the accuracy and quality of the measurements. The quality standards that the meters need to comply is “The ICE/TSE 62053-22: Electricity metering equipment (a.c) – Particular requirements - Part 22: Static meters for active energy (Classes 0,2 S and 0,5 S)” The calibration of the meters is done, and the meters are checked continuously if there is a difference of 0.5 % in the readings of the main and the auxiliary meters, the calibration is repeated.

The net electricity produced is calculated by subtracting the total electricity consumed by the hydroelectric power plant, from the gross electricity generation and a certain percentage is lost during the transmission. After obtaining the net electricity production value, the emission reductions are calculated by multiplying the net electricity with the Combined Margin calculated above.

The monitoring is conducted by the Verified Emission Reduction (VER) Monitoring Team. The VER Team Members, and their position and duties for the monitoring is outlined in the following table (Table 5):

Table 4: Positions and responsibilities of the VER monitoring team members.

Position	Responsibility
----------	----------------

Düzce-Aksu HEPP Manager	Day to day operation of the Düzce-Aksu HEPP, Compliance of the project activity with the host country rules and regulations Coordination of the data collection and recording for the VCS monitoring report.
Chief Electrical Engineer	Day to day follow up of electrical equipment Recording and monitoring of the electricity generation data
Accounts Manager	Data keeping for power sales Data entry to EPIAŞ system
Chief Mechanical Engineer	Day to day operation of the power plant Keeping records of malfunctions and repairs
Carbon Consultant	Emission reduction calculations Scripting of the periodic monitoring report Follow up of the verification process

The power generation meter readings are performed by using the main metering devices and the auxiliary metering devices for accuracy checks only. Data from metering devices is recorded by TEİAŞ and form the basis for the electricity production data. In addition to the readings of the main and auxiliary (back-up) metering devices, generation data of the DÜZCE AKSU HEPP can be cross checked, via the TEİAŞ – EPIAŞ web site (<https://seffaflik.epias.com.tr/transparency/>) which is accessible by a password available to the electricity generation companies (in the case of project activity the project owner has this capacity). The electricity generation data at the Market Financial Reconciliation Centre (MFRC/EPIAŞ) web page exhibits the net electricity generated less transmission loss, to be able to produce comparable numbers, the figures taken from EPIAŞ web site needs to be multiplied by the transmission loss factor of the grid. This data is the main QA/QC data for the project activity.

The two electricity metering devices were replaced with new ones on 13/06/2021 as the previous ones reached their end of validity period of 10 years.

Meter Serial Number	Brand	Calibration Year	Valid Until	Accuracy Class
Main Meter:10172379	EMH	2011	2021	0.2S (+-%1)
Control Meter:10172380	EMH	2011	2021	0.2S (+-%1)
Main Meter: 65000766	ITRON	2021	2031	0.5S (+-%1)
Control Meter: 65000767	ITRON	2021	2031	0.5S (+-%1)

5 QUANTIFICATION OF GHG EMISSION REDUCTIONS AND REMOVALS

calculated according to the formula

$$BE_y = EG_y \times EF_y$$

Where:

EG_y = Net electricity delivered to the grid by the project activity in year y excluding transmission losses of the grid.

EF_y = Emission factor calculated according to selected methodology

5.1 Project Emissions

The proposed project activity involves the generation of electricity by hydroelectric power plant therefore project activity does not result in greenhouse gas emissions. Power density of the projects higher than 10 W-m² for 46.200 MWe installed capacity and 707 m² maximum lake area.

The power density of the project activity (PD) is calculated as follows:

$$PD = \frac{Cap_{PJ} - Cap_{BL}}{A_{PJ} - A_{BL}}$$

Where:

PD = Power density of the project activity (W-m²)

Cap_{PJ} = Installed capacity of the hydro power plant after the implementation of the project activity (W)

Cap_{BL} = Installed capacity of the hydro power plant before the implementation of the project activity (W). For new hydro power plants, this value is zero

A_{PJ} = Area of the reservoir measured in the surface of the water, after the implementation of the project activity, when the reservoir is full (m²)

A_{BL} = Area of the reservoir measured in the surface of the water, before the implementation of the project activity, when the reservoir is full (m²). For new reservoirs, this value is zero.

For proposed project HEPP,

$Cap_{PJ} = 46,200,000 \text{ We}$

$Cap_{BL} = 0.0 \text{ W}$

$A_{PJ} = 707 \text{ (m}^2\text{)}^9$

⁹ Reservoir area, Appendix 2

$$ABL = 0.0 \text{ (m}^2\text{)}$$

Therefore, PD is calculated as.

$$PD = \frac{46,200,000 - 0}{707 - 0}$$

$$PD = 65346.53 \text{ W} - \text{m}^2$$

Since the power density (PD) of the project activities is greater than 10 W/m², Project Emissions (PE) are considered 0¹⁰

5.2 Leakage

The energy generating equipment is not transferred from or to another activity. Therefore, leakage is also considered as “0”.

$$LE_y = 0$$

5.3 Net GHG Emission Reductions and Removals

Total Emission Reduction has been determined as;

$$ER_y = BE_y - PE_y - LE_y$$

Where;

ER_y = Emission reductions in year y (tCO₂)

BE_y = Baseline emissions in year y (tCO₂)

PE_y = Project Emissions in year y (tCO₂)

LE_y = Leakage emissions in year y (tCO₂)

The project emissions and leakage are considered as “0”. Thus, ER_y = BE_y

Table 5. Calculations for net total values

EG _y	Net Generation (MWh) During Monitoring Period	97,222
EF _y	Emission Factor (tCO ₂ -MWh)	0.5332 ¹¹
BE _y	Baseline emissions in year y (tCO ₂) During Monitoring Period	0
PE _y	Project Emissions (tCO ₂)	0

¹⁰ ACM0002 “Consolidated baseline methodology for grid-connected electricity generation from renewable sources.” Ver 16

¹¹ Fixed ex-ante CM as per Section 4.3. og registered PD

LEy	Leakage Emissions (tCO ₂)	0
ERy	Net Emission Reduction (tCO ₂) During Monitoring Period	51,842

Thus, the net emission reduction (in tons CO₂) in this monitoring period (01-10-2020 to 31.12.2021) is calculated as given in table below.

Table 6. Summary of Emission Reductions

Year	Baseline Emissions (tCO ₂ e)	Project Emissions (tCO ₂ e)	Leakage Emissions (tCO ₂ e)	Net GHG Emission Reductions or Removals (tCO ₂ e)
2020 (01/10/2020 – 31/12/2020)	724	0	0	724
2021 (01/01/2021 – 31/12/2021)	51,118	0	0	51,118
Total	51,842	0	0	51,842

Total emission reductions were realized as 51,842 tCO₂ for this monitoring period (Table 7). When the estimated electricity generation figure of the power plant for each year in the validated VCS PD (141,370 MWh-year) is considered, the total emission reductions should be approximately 94,228 tCO₂ for the monitoring period (15 months). Percent difference is calculated as -45.0%, which means the project reduced 45.0% less CO₂ than the estimated amount. Since the project is a HEPP, seasonal effects are significant on the monthly generation rates and deviations from the calculated values are acceptable. On the other hand, the electricity generation is dependent on water flow estimation, which is a natural phenomenon and cannot be estimated with 100% accuracy.

Table 7. Summary of net electricity supply to the grid versus emissions reductions (estimate and actual values for this monitoring period)

	Project Baseline Estimate		Actual Values Achieved in the Monitoring Period	
Year	Net Electricity Supplied to the Grid (MWh)	Emission Reductions (tCO ₂ e)	Net Electricity Supplied to the Grid (MWh)	Emission Reductions (tCO ₂ e)
2020	35,343	18,846	1,357	724

2021	141,370	75,383	95,865	51,118
Total	176,713	94,228	97,222	51,842


APPENDIX 1: SINGLE LINE DIAGRAM

BAĞLANTI ANLAŞMASI

EK-3

MÜLKİYET SINIRLARI


- a) Mülkiyet sınırının yazılı ifadesi: : Üretim Tesisi Şalt Sahasından sonraki nihayet direği ile Üretim Tesisi Şalt Sahası arasındaki gevşek bağlantı hariç, tesis edilecek enerji iletim hatları TEİAŞ'ın mülkiyetindedir.
- b) Mülkiyet sınırının Prensip Tek Hat Şeması üzerinde gösterimi:

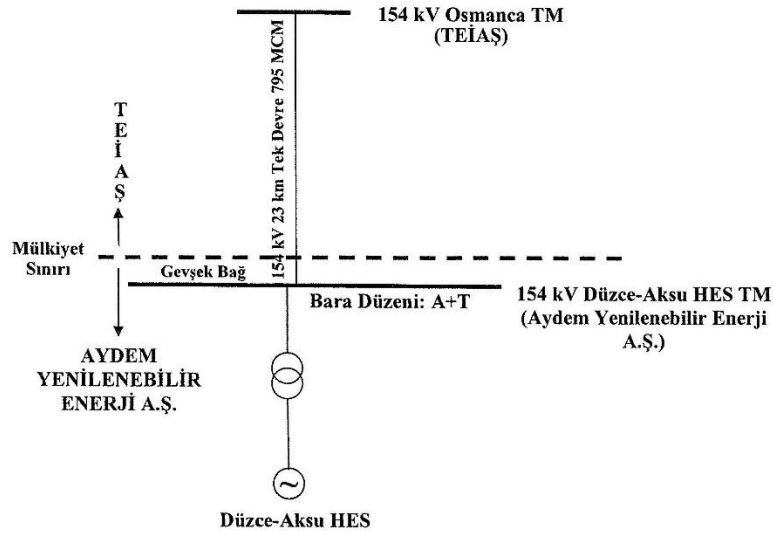

AYDEM YENİLENEBİLİR
ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.
AYDEM YENİLENEBİLİR ENERJİ A.Ş.



APPENDIX 2: RESERVOIR AREA

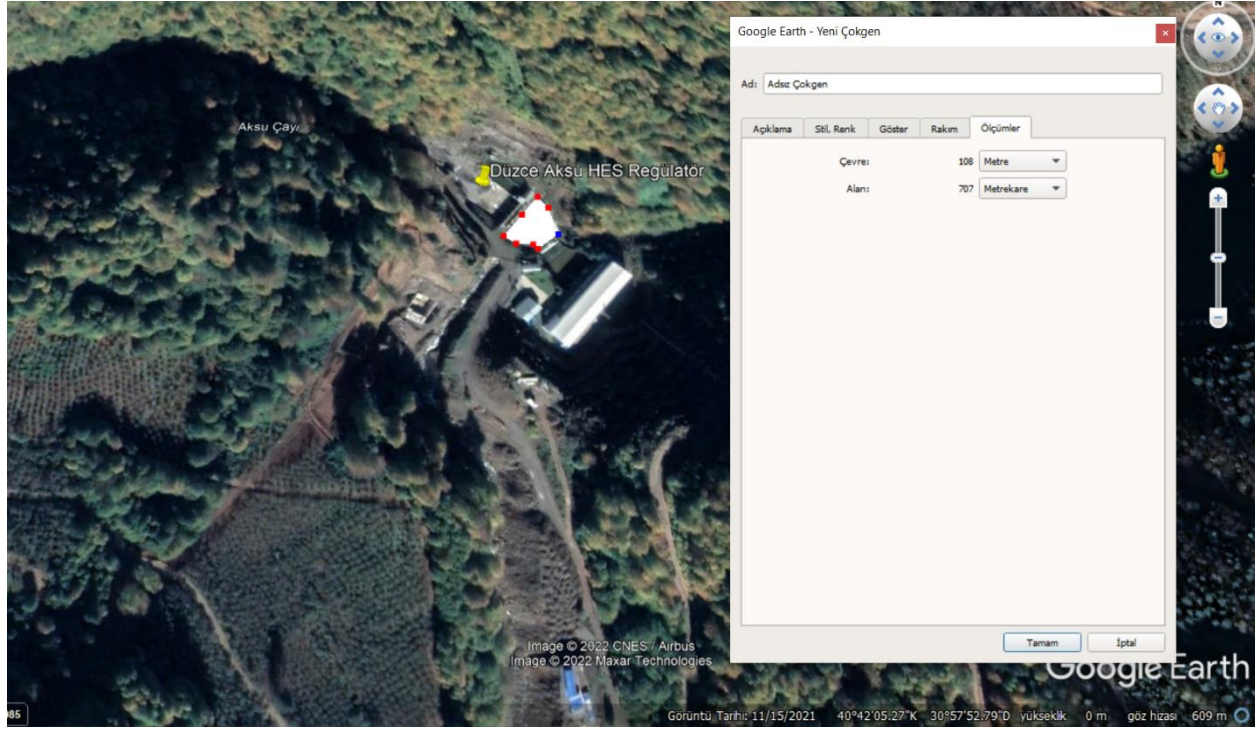

APPENDIX 3: RESERVOIR AREA USED IN PD VER 2.03

